

## STR700 SmartLine Remote Diaphragm Seals Specification 34-ST-03-104



### Introduction

Part of the SmartLine® family of products, the STR700 is suitable for monitoring, control and data acquisition. STR700 products feature piezoresistive sensor technology combining pressure sensing with on chip temperature compensation capabilities providing high accuracy, stability and performance over a wide range of application pressures and temperatures.

The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications



Figure 1 – STR700 Remote Diaphragm Seal Unit

### Best in Class Transmitter Features:

- Accuracies up to 0.075% Span standard
- Automatic static pressure & temperature compensation
- Rangeability up to 100:1
- Local display capabilities
- External zero, span, & configuration capability
- Polarity insensitive electrical connections
- Comprehensive on-board diagnostic capabilities
- Integral Dual Seal design for highest safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0
- World class overpressure protection
- Full compliance to SIL 2/3 requirements.
- Modular design characteristics

### Typical Diaphragm Seal applications

- High Process Temperatures
- Viscous or Suspended Solids
- Highly Corrosive Process Materials
- Sanitary Applications
- Applications with Hydrogen Permeation Possibilities
- Level Applications with Maintenance Intensive Wet Legs
- Applications requiring remote Transmitter Mounting
- Tank Applications with Density or Interface Measurements

### Remote Seal/Transmitter Span & Range Limits:

Model	URL psid (bar)	LRL psid (bar)	Max Span psid (bar)	Min Span psid (bar)
STR73D	100 (7.0)	-100 (-7.0)	100 (7.0)	0.9 (0.062)
Model	psig (bar)	psig (bar)	psig (bar)	psig (bar)
STR74G	500 (35.0)	-14.7 (-1.0)	500 (35.0)	5 (0.35)

### Communications/Output Options:

- Honeywell Digitally Enhanced (DE)
- HART® (version 7.0)
- FOUNDATION™ Fieldbus

All transmitters are available with the above listed communications protocols.

## Description

The SmartLine family pressure transmitters are designed around a high performance piezo-resistive sensor. This one sensor actually integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements. This level of performance allows the ST 700 to replace most competitive transmitters available today.

## Indication/Display Option

The ST 700 modular design accommodates a basic alphanumeric LCD display.

### Basic Alphanumeric LCD Display Features

- Modular (may be added or removed in the field)
- 0, 90, 180, & 270 degree position adjustments
- Configurable (HART only) and standard (Pa, KPa, MPa, KGcm<sup>2</sup>, Torr, ATM, inH<sub>2</sub>O, mH<sub>2</sub>O, bar, mbar, inH<sub>2</sub>O, inHG, FTH<sub>2</sub>O, mmH<sub>2</sub>O, mm HG, & psi) measurement units
- 2 Lines 16 Characters (4.13H x 1.83W mm)
- Square root output indication ( $\sqrt{\phantom{x}}$ )

## Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing **lower overall operational costs**

## Configuration Tools

### Integral Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offers the ability to configure the transmitter and display via three externally accessible buttons when a display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of the display option.

### Hand Held Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. This is accomplished via Honeywell's field-rated Multiple Communication Configurator (MCT202). The MCT202 is capable of field configuring DE and HART Devices and can also be ordered for use in intrinsically safe environments. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any properly validated hand held configuration device.

## Personal Computer Configuration

Honeywell's SCT 3000 Configuration Toolkit provides an easy way to configure Digitally Enhanced (DE) instruments using a personal computer as the configuration interface. Field Device Manager (FDM) Software and FDM Express are also available for managing HART & Fieldbus device configurations.

## System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE/Fieldbus.
- Integration with Honeywell's Experion PKS offers the following unique advantages.
  - Tamper reporting
  - FDM Plant Area Views with Health summaries
  - All ST 700 units are Experion tested to provide the highest level of compatibility assurance

## Modular Design

To help contain maintenance & inventory costs, all ST 700 transmitters are modular in design supporting the user's ability to replace meter bodies, add indicators or change electronic modules without affecting overall performance or approval body certifications. Each meter body is uniquely characterized to provide in-tolerance performance over a wide range of application variations in temperature and pressure and due to the Honeywell advanced interface, electronic modules may be swapped with any electronics module without losing in-tolerance performance characteristics.

### Modular Features

- Meter body replacement
- Exchange/replace electronics/comms modules\*
- Add or remove integral indicator\*
- Add or remove lightning protection (terminal connection)\*

\* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell's unique modularity results in **lower inventory needs and lower overall operating costs**.

## Performance Specifications

### Reference Accuracy (conformance to +/-3 Sigma)

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Reference Accuracy <sup>1,2</sup> (% Span)
STR73D	100 psid/7.0 bar	-100 psi/-7.0bar	0.9 psi/.062bar	100:1	0.075
STR74G	500 psi/35 bar	-14.7 psi/-1.0 bar	5 psi/.035 bar	100:1	0.075

Zero and span may be set anywhere within the listed (URL/LRL) range limits

		Accuracy <sup>1,2</sup> (% of Span)				Temperature Effect <sup>3</sup> (%Span/50°F)		
Model	URL	Turn down greater than	A	B	C psi(bar)	D	E	F psi(bar)
STR73D	100 psi/7.0 bar	27.7:1	0.0250	0.050	3.61 (0.249)	0.028	1.200	7.2 (0.50)
STR74G	500 psig/35 bar	25:1	0.0250	0.050	20 (1.4)			
		Turn Down Effect $\pm \left[ A + B \left( \frac{C}{\text{Span}} \right) \right]$ % Span				Temp Effect $\pm \left[ D + E \left( \frac{F}{\text{Span}} \right) \right]$ % Span per 28°C (50°F)		

### Accuracy at Specified Span, Temperature and Static Pressure: (conformance to +/-3 Sigma)

#### Total Performance (% of Span):

$$\text{Total Performance} = \pm \sqrt{(\text{Accuracy})^2 + (\text{Temp Effect})^2}$$

**Total Performance Examples:** (5:1 Turndown, up to 50 °F shift)

**STR73D @ 20 psid:** 1.03% of span

#### Typical Calibration Frequency:

Calibration verification is recommended every four (4) years

#### Notes:

1. Terminal Based Accuracy – Includes combined effects of linearity, hysteresis, and repeatability. Analog output adds 0.005% of span.
2. For zero based spans and reference conditions of 25°C (77°F), 0 psi static pressure for DP, >= 0 psia for GP, 10 to 55% R.H, and 316Stainless Steel barrier diaphragms
3. Specification applies to transmitter with 2 balanced remote seals. Apply a factor of 1.5 for temperature effect of capillary lengths greater than 10 feet.

## Operating Conditions – All Models

Parameter	Reference Condition (at zero static)		Rated Condition		Operative Limits		Transportation and Storage							
	°C	°F	°C	°F	°C	°F	°C	°F						
Ambient Temperature <sup>1</sup>	25±1	77±2	-	-	-	-	-55 to 90	-67 to 194						
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100							
Vacuum Region, Minimum Pressure mmHg absolute	Atmospheric (See <a href="#">Figure 4</a> for vacuum limitation)													
Supply Voltage, Current, and Load Resistance	10.8 to 42.4 Vdc at terminals (IS versions limited to 30 Vdc) 0 to 1,440 ohms (as shown in Figure 2)													
Maximum Allowable Working Pressure (MAWP) <sup>4</sup>  (ST 700 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	MAWP is minimum of Body Rating or Seal Rating (See Model Selection Guide for Seal MAWP) <table><tr><td>Body</td><td>MAWP</td></tr><tr><td>STR73D</td><td>750 psig (51.7 bar) Bolted Process Heads</td></tr><tr><td>STR74G</td><td>500 psig (35 bar)</td></tr></table>								Body	MAWP	STR73D	750 psig (51.7 bar) Bolted Process Heads	STR74G	500 psig (35 bar)
Body	MAWP													
STR73D	750 psig (51.7 bar) Bolted Process Heads													
STR74G	500 psig (35 bar)													

<sup>1</sup> Ambient Temperature Limit is a function of Process Interface Temperature. (See Figures 3 & 4)

LCD Display operating temperature -20°C to +70°C . Storage temperature -30°C to 80°C

<sup>4</sup> Consult factory for MAWP of ST 700 transmitters with CRN approval.

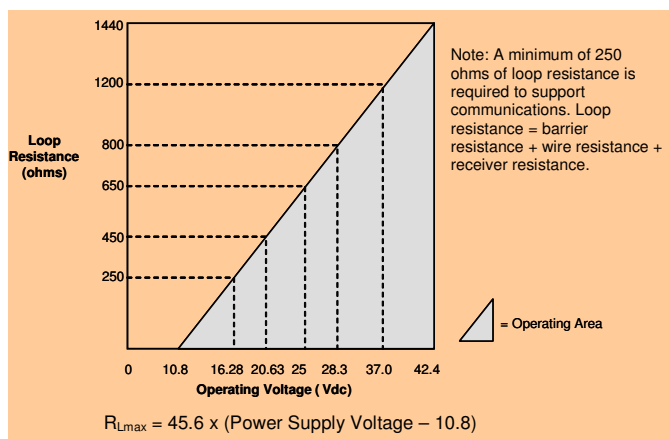


Figure 2 - Supply voltage and loop resistance

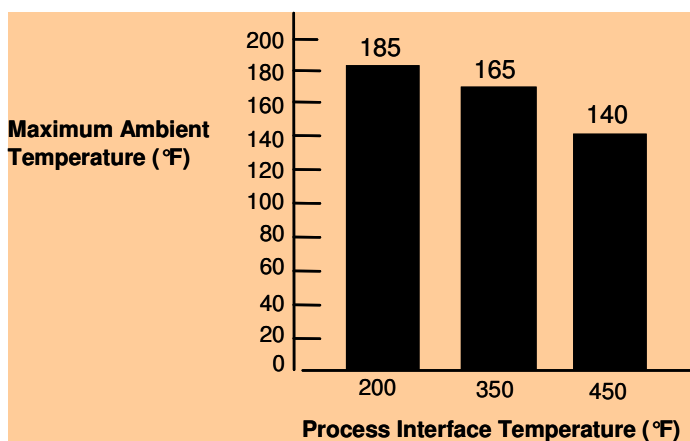


Figure 3 - Ambient temperature Limits

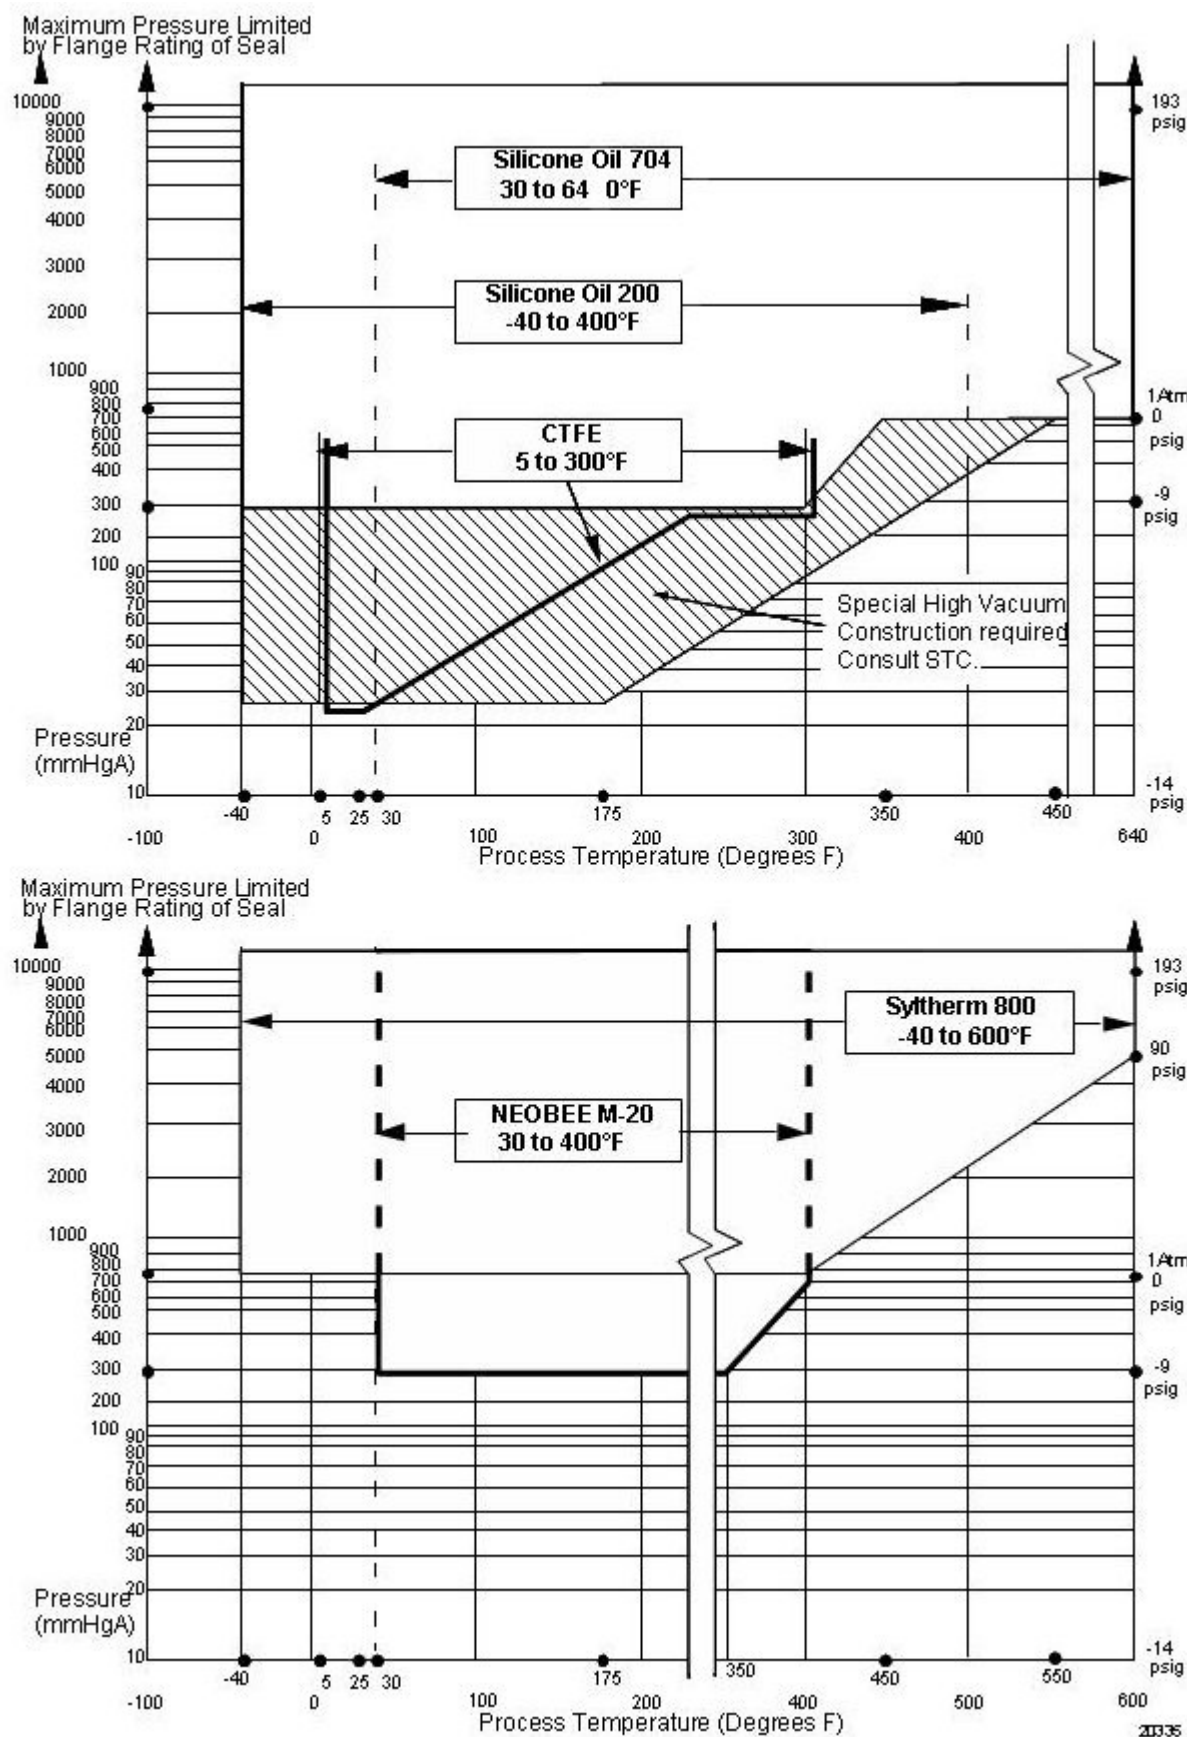


Figure 4 - STR700 Remote Seals operable limits for pressure vs. temperature

## Performance Under Rated Conditions – All Models

Parameter	Description									
Analog Output Digital Communications:	Two-wire, 4 to 20 mA (HART & DE Transmitters only) Honeywell DE, HART 7 protocol or FOUNDATION Fieldbus ITK 6.0.1 compliant All transmitters, irrespective of protocol have polarity insensitive connection.									
HART & DE Output Failure Modes (NAMUR for DE Units requires selecting display and configuration buttons or factory configuration)	<table><tr><th></th><th>Honeywell Standard:</th><th>NAMUR NE 43 Compliance:</th></tr><tr><td>Normal Limits:</td><td>3.8 – 20.8 mA</td><td>3.8 – 20.5 mA</td></tr><tr><td>Failure Mode:</td><td>≤ 3.6 mA and ≥ 21.0 mA</td><td>≤ 3.6 mA and ≥ 21.0 mA</td></tr></table>		Honeywell Standard:	NAMUR NE 43 Compliance:	Normal Limits:	3.8 – 20.8 mA	3.8 – 20.5 mA	Failure Mode:	≤ 3.6 mA and ≥ 21.0 mA	≤ 3.6 mA and ≥ 21.0 mA
	Honeywell Standard:	NAMUR NE 43 Compliance:								
Normal Limits:	3.8 – 20.8 mA	3.8 – 20.5 mA								
Failure Mode:	≤ 3.6 mA and ≥ 21.0 mA	≤ 3.6 mA and ≥ 21.0 mA								
Supply Voltage Effect	0.005% span per volt.									
Transmitter Turn on Time (includes power up & test algorithms)	HART or DE: 2.5 sec.									

## Materials Specifications (see model selection guide for availability/restrictions with various models)

Parameter	Description										
<b>Process Interface</b>	See Model Selection Guide for Material Options for desired seal type.										
<b>Seal Barrier Diaphragm</b>	316L Stainless Steel, Monel®, Hastelloy® C, Tantalum										
<b>Seal Gasket Materials</b>	Klinger C-4401 (non-asbestos) Grafoil®, Teflon®, Gylon 3510®										
<b>Mounting Bracket</b>	Carbon Steel (Zinc-Chromate plated) or 304 Stainless Steel or 316 Stainless Steel.										
<b>Fill Fluid (Meter Body)</b>	<table> <tr> <td>Silicone 200</td><td>S.G. @ 25°C = 0.94</td></tr> <tr> <td>CTFE (Chlorotrifluoroethylene)</td><td>S.G. @ 25°C = 1.89</td></tr> <tr> <td>Silicone 704</td><td>S.G. @ 25°C = 1.07</td></tr> <tr> <td>NEOBEE M-20®</td><td>S.G. @ 25°C = 0.93</td></tr> </table>	Silicone 200	S.G. @ 25°C = 0.94	CTFE (Chlorotrifluoroethylene)	S.G. @ 25°C = 1.89	Silicone 704	S.G. @ 25°C = 1.07	NEOBEE M-20®	S.G. @ 25°C = 0.93		
Silicone 200	S.G. @ 25°C = 0.94										
CTFE (Chlorotrifluoroethylene)	S.G. @ 25°C = 1.89										
Silicone 704	S.G. @ 25°C = 1.07										
NEOBEE M-20®	S.G. @ 25°C = 0.93										
<b>Fill Fluid (Secondary)</b>	<table> <tr> <td>Silicone 200</td><td>S.G. @ 25°C = 0.94</td></tr> <tr> <td>CTFE (Chlorotrifluoroethylene)</td><td>S.G. @ 25°C = 1.89</td></tr> <tr> <td>Silicone 704</td><td>S.G. @ 25°C = 1.07</td></tr> <tr> <td>Syltherm 800®</td><td>S.G. @ 25°C = 0.90</td></tr> <tr> <td>NEOBEE M-20®</td><td>S.G. @ 25°C = 0.93</td></tr> </table>	Silicone 200	S.G. @ 25°C = 0.94	CTFE (Chlorotrifluoroethylene)	S.G. @ 25°C = 1.89	Silicone 704	S.G. @ 25°C = 1.07	Syltherm 800®	S.G. @ 25°C = 0.90	NEOBEE M-20®	S.G. @ 25°C = 0.93
Silicone 200	S.G. @ 25°C = 0.94										
CTFE (Chlorotrifluoroethylene)	S.G. @ 25°C = 1.89										
Silicone 704	S.G. @ 25°C = 1.07										
Syltherm 800®	S.G. @ 25°C = 0.90										
NEOBEE M-20®	S.G. @ 25°C = 0.93										
<b>Electronic Housing</b>	Pure Polyester Powder Coated Low Copper (<0.4%)-Aluminum. Meets NEMA 4X, IP66, & P67. All stainless steel housing is optional.										
<b>Capillary Tubing</b>	<p><b>Material:</b> Armored Stainless Steel or PVC Coated Armored Stainless Steel.  <b>Length:</b> 5, 10, 15, 20, 25, and 35 feet (1.5, 3, 4.6, 6.1, 7.5, and 10.7 meters).            A 2 inch (51 millimeter) S.S. close-coupled nipple is also available. See Model Selection Guide.            Refer to <a href="#">Figure 5</a> for guide to maximum capillary length vs. diaphragm diameter. <b>Note:</b> The minimum span is the higher of the higher of the value from the table above or the value defined under the Performance Conditions for the range transmitter.</p> <p style="text-align: center;"><b>Figure 5</b></p>										
<b>Wiring</b>	Accepts up to 16 AWG (1.5 mm diameter)										
<b>Mounting</b>	<a href="#">See Figure 6</a>										
<b>Dimensions</b>	<b>Transmitter:</b> See <a href="#">Figures 7a</a> and <a href="#">7b</a> . <b>Seal:</b> See <a href="#">Figure 8</a> through <a href="#">Figure 15</a>										
<b>Net Weight</b>	<b>Transmitter:</b> 8.3 pounds (3.8 Kg). With Aluminum Housing. Total weight is dependent on seal										

**NOTE:** Pressure transmitters that are part of safety equipment for the protection of piping (systems) or vessel(s) from exceeding allowable pressure limits, (equipment with safety functions in accordance with Pressure Equipment Directive 97/23/EC article 1, 2.1.3), require separate examination.

**Minimum recommended span for STR73D Transmitter with two Seals**


Diaphragm Size (Inch)	Capillary Length (Feet)						Maximum Capillary Length (Feet)
	5	10	15	20	25	35	
1.9	15 psi	20 psi	25 psi	-	-	-	15
2.4	5.4 psi	7.2 psi	9.0 psi	10.8 psi	12.6 psi	14.4 psi	35
2.9	1.8 psi	2.7 psi	3.6 psi	4.5 psi	5.4 psi	7.2 psi	35
3.5	0.9 psi	0.9 psi	0.9 psi	1.0 psi	1.2 psi	1.4 psi	35
4.1	0.9 psi	0.9 psi	0.9 psi	0.9 psi	0.9 psi	1.1 psi	35

**Minimum recommended span for STR74G and STR73D Transmitter with one Remote Seal**

Diaphragm Size (Inch)	Direct Mount	Capillary Length (Feet)						Maximum Capillary Length (Feet)
		5	10	15	20	25	35	
1.9	25 psi	30 psi	40 psi	50 psi	-	-	-	15
2.4	10 psi	15 psi	20 psi	25 psi	30 psi	35 psi	50 psi	35
2.9	8 psi	9 psi	10 psi	11 psi	12 psi	13 psi	15 psi	35
3.5	2 psi	2 psi	3 psi	4 psi	5 psi	6 psi	8 psi	35
4.1	0.9 psi	0.9 psi	1 psi	2 psi	3 psi	3.5 psi	5 psi	35

**Note:** The minimum span is the higher of the higher of the value from the table above or the value defined under the Performance Conditions for the range transmitter.

**Figure 5– Typical Maximum capillary length and diaphragm size chart**

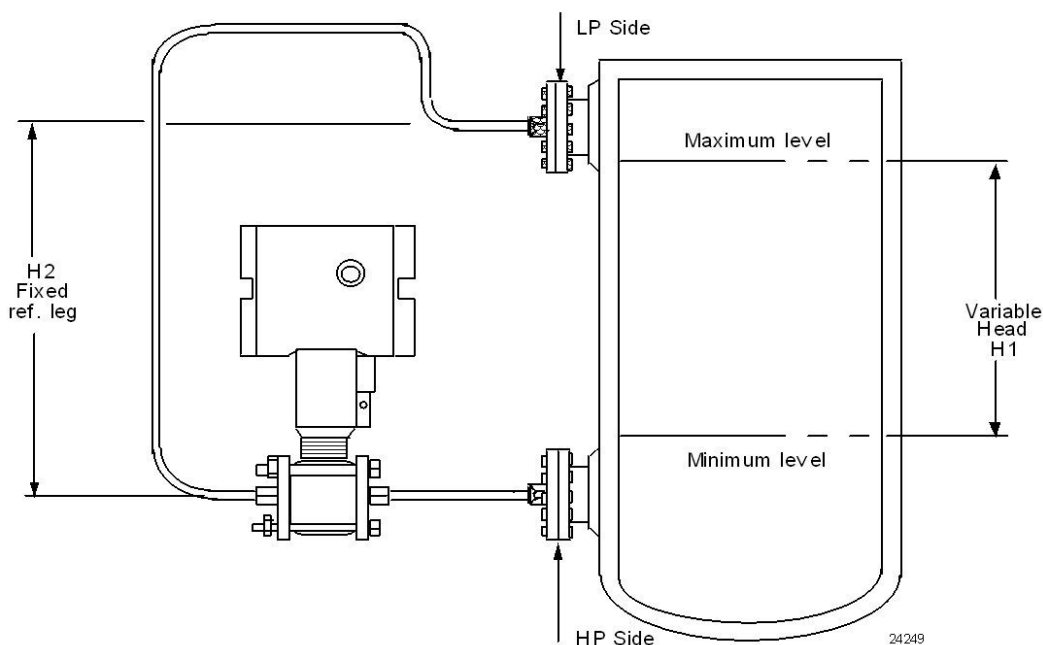



NOTE: Lower flange seal should not be mounted over 22 feet below or above the transmitter for silicone fill fluid (11 feet for CTFE fill fluid) with tank at one atmosphere. The combination of tank vacuum and high pressure capillary head effect should not exceed 9 psi vacuum (300 mmHg absolute).

Consult Honeywell for installation of STR73D.

**Figure 6 - STR700 transmitter with remote diaphragm seals shown mounted on a tank**



### Reference Dimensions Horizontal Mounting

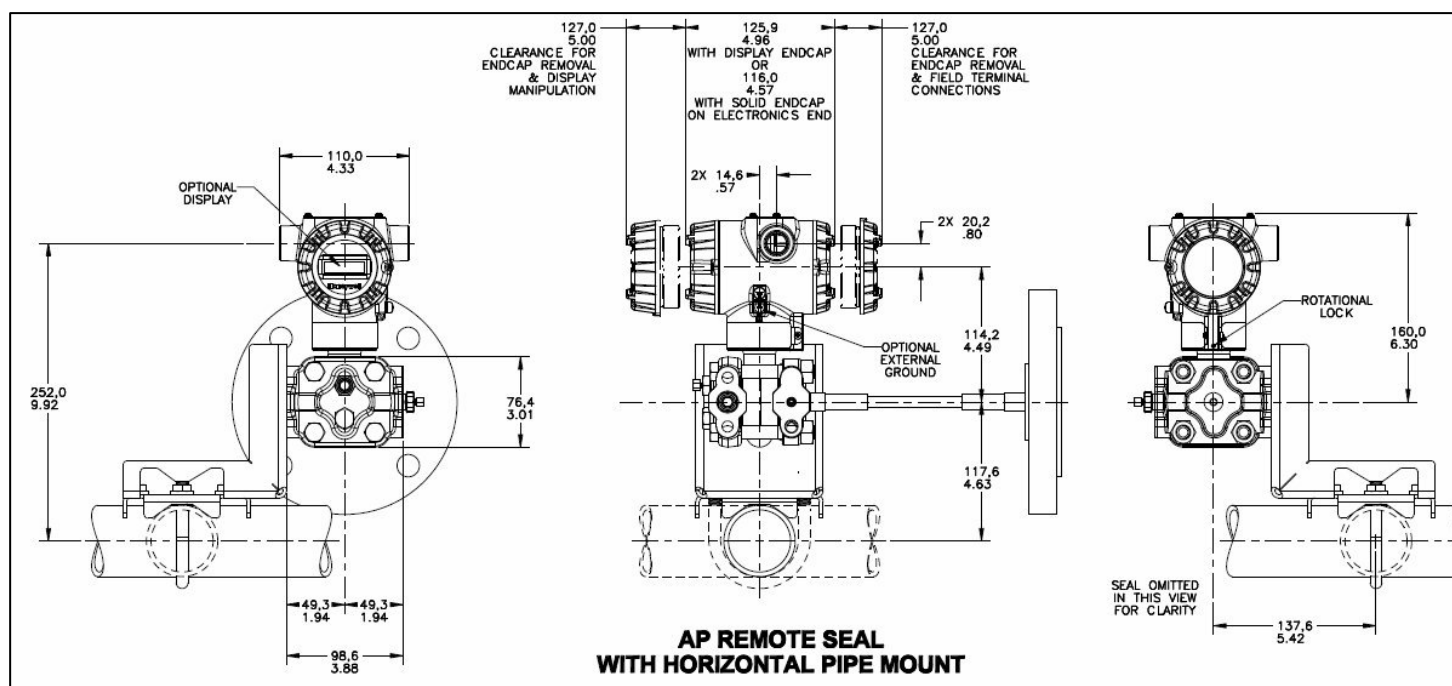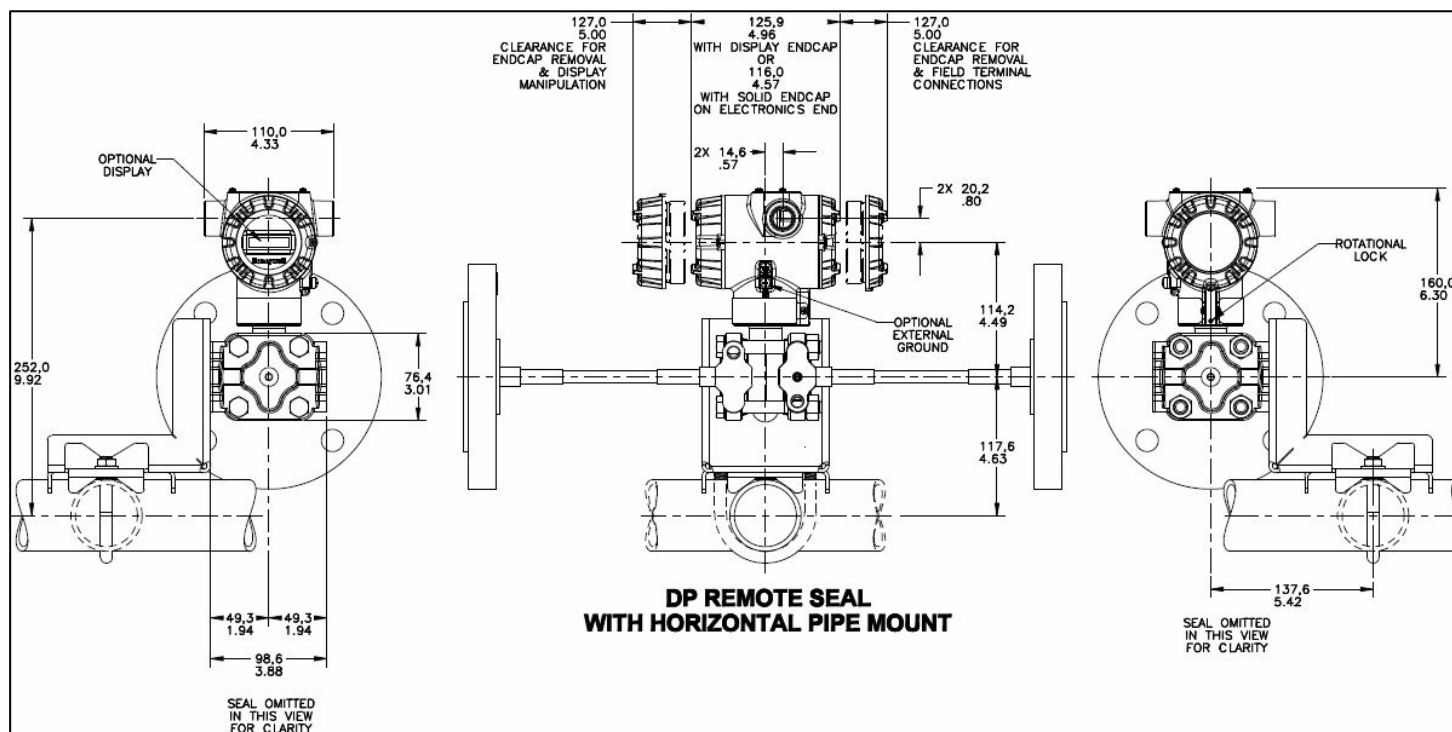



Reference Dimensions Horizontal Mounting (cont'd)


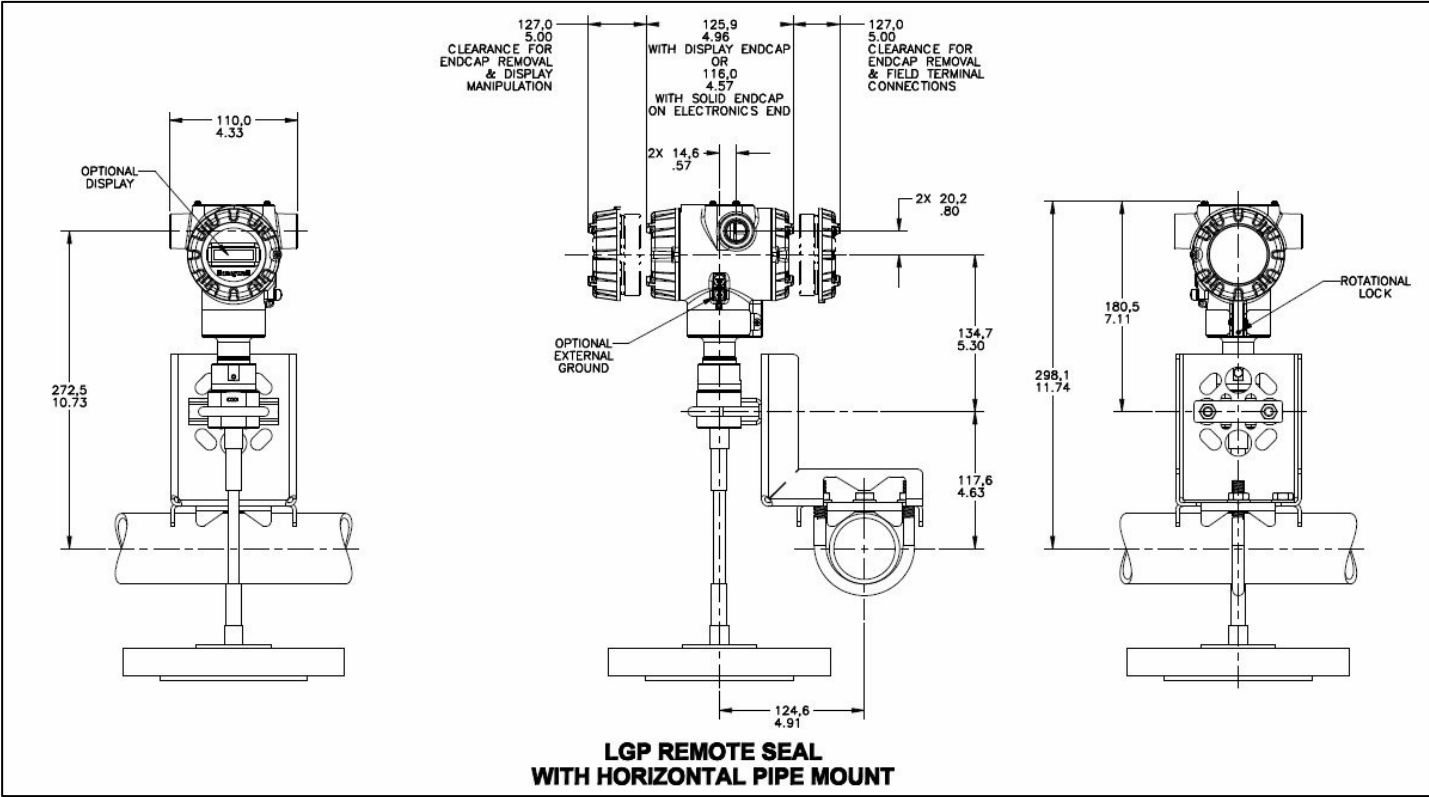


Figure 7 — Approximate horizontal mounting dimensions for Remote Seal Transmitter

Reference Dimensions Vertical Mounting

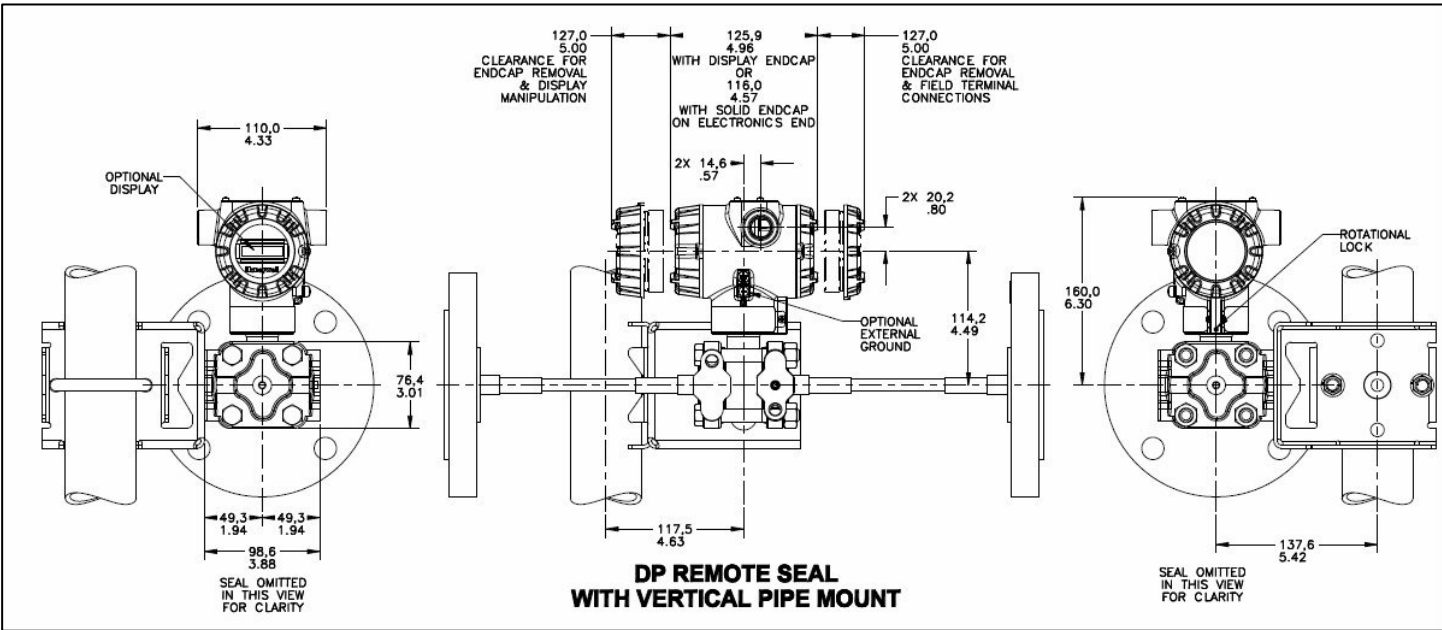

## Reference Dimensions Vertical Mounting (cont'd)



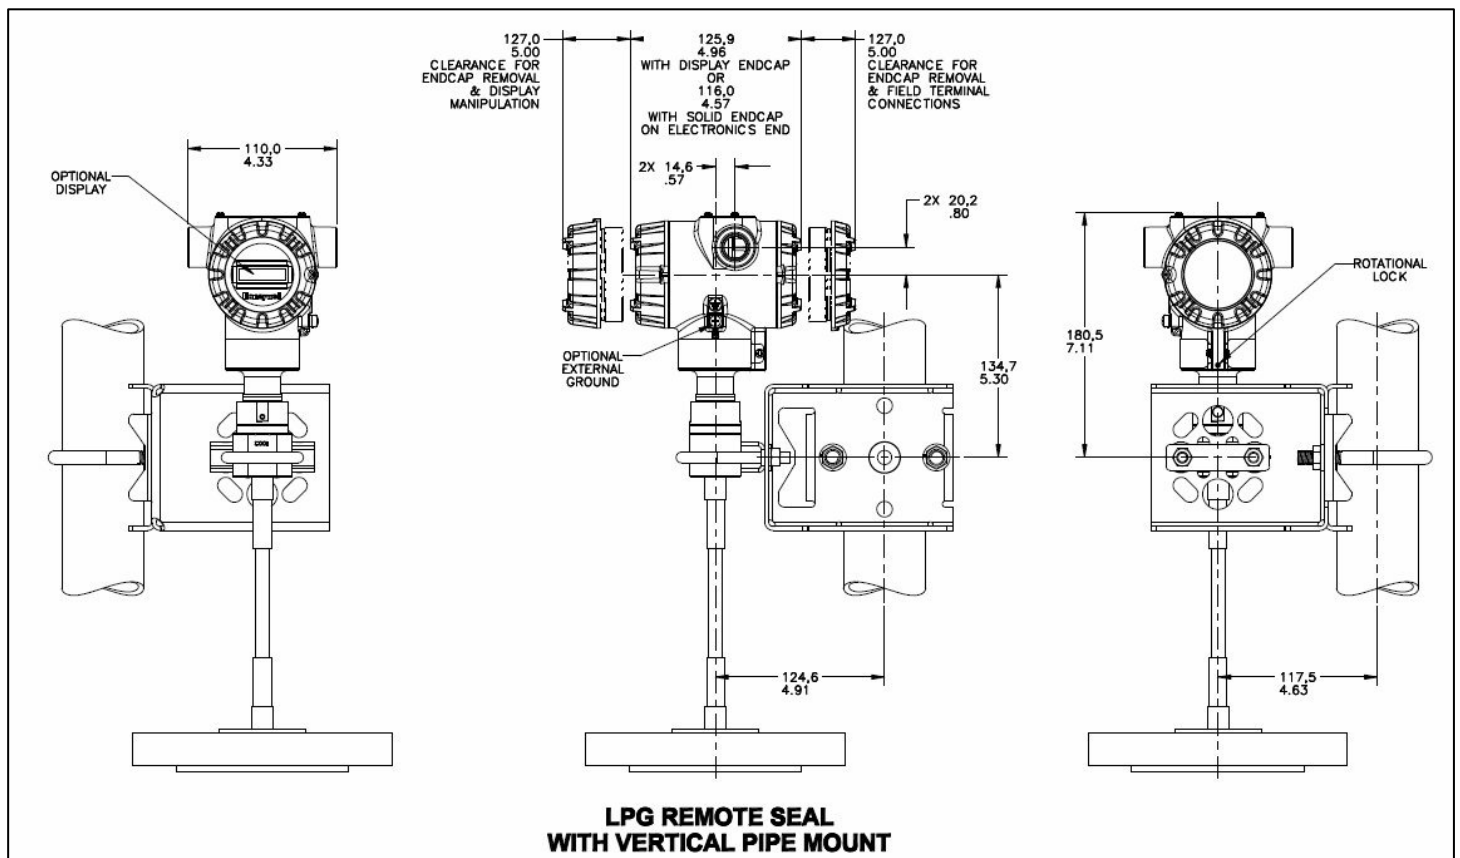


Figure 8 — Approximate vertical mounting dimensions for Remote Seal Transmitter

## Reference Dimensions (cont'd)


### Flush Flanged Seal Dimensions

Type	ANSI/DIN Rating	Flange Material	Wetted Materials		Construction See figure	↔ ↑	
			Diaphragm	Body		A	B
Flush Flanged Seal	3" Class 150#	CS	SS	SS	D	7.5	1.37
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
		SS	Tantalum	SS	C	7.50	0.94
			SS	N/A	B		1.37
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		
	3" Class 300#	CS	Monel	Monel	D	8.25	1.56
			Tantalum	SS	C		
		SS	SS	N/A	B		1.12
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D	8.25	1.56
			Monel	Monel	D		
	3" Class 600#	CS	Tantalum	SS	C	8.25	1.75
			SS	N/A	B		1.5
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D	8.25	1.75
		SS	Monel	Monel	D		
			Tantalum	SS	C	7.87	1.32
	DN80-PN40	CS	SS	SS	D		0.94
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D	7.87	1.32
		SS	Tantalum	SS	C		
			SS	N/A	B		
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
			Tantalum	SS	C		

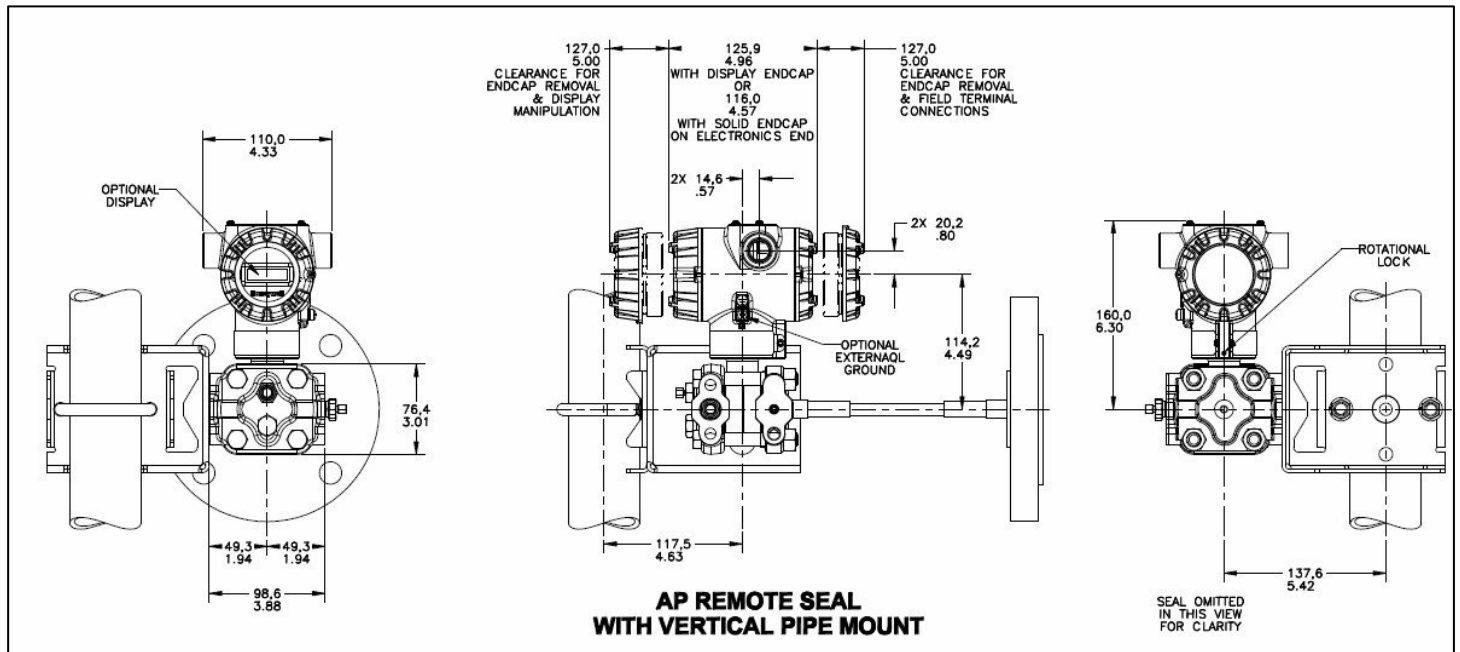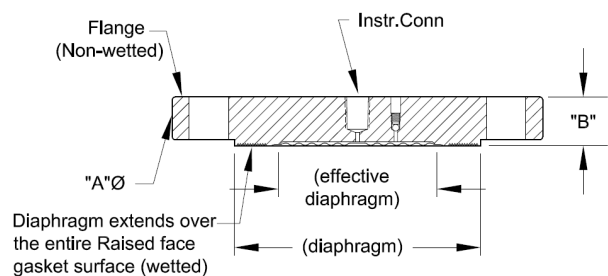


Configuration "HS"

Figure A

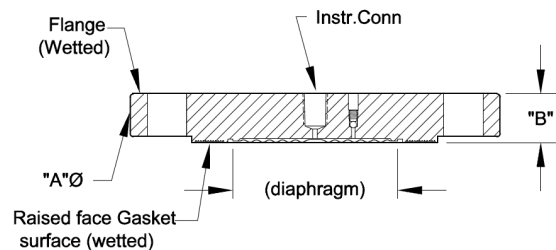


Configuration "HT"

Figure B

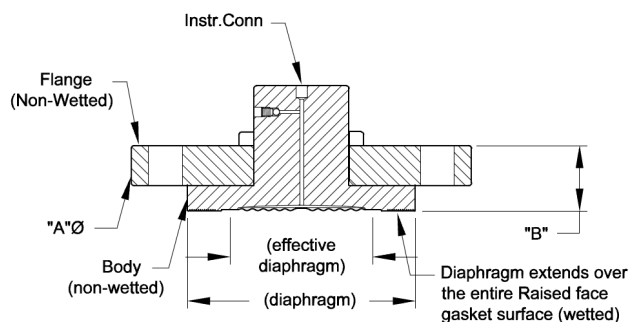

Configuration "IS"

Figure C

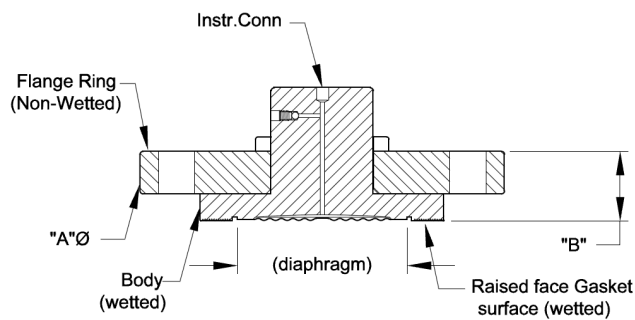

Configuration "IT"

Figure D


Figure 9 - Seal Dimensions (Flush Flanged)

## Reference Dimensions (cont'd)


### Flush Flanged Seal with Lower

Type	ANSI/DIN Rating	Size	Dimension	2.4" Diaph. Dia. (in.)	2.9" Diaph. Dia. (in.)	4.1" Diaph. Dia. (in.)
Flush Flanged Seal with Lower	Class 150#	1/2"	A	3.50	4.00	5.25
			B0	1.72	1.72	1.84
			B1	1.72	1.72	1.84
			B2	2.22	2.22	2.34
		1"	A	4.25	4.00	5.25
			B0	1.12	1.72	1.84
			B1	1.62	1.72	1.84
			B2	1.98	1.72	2.34
		1-1/2"	A	5.00	5.00	5.25
			B0	2.50	2.50	1.78
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		2"	A	6.00	6.00	6.00
			B0	2.50	2.50	2.12
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		3"	A	7.50	7.50	7.50
			B0	2.58	2.88	2.60
			B1	2.88	2.88	3.00
			B2	3.50	3.40	3.40
	Class 300#	1"	A	4.88	4.00	5.25
			B0	2.50	1.72	1.88
			B1	3.00	1.72	2.12
			B2	3.50	2.22	2.12
		1-1/2"	A	6.12	6.12	5.25
			B0	2.50	2.50	2.12
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		2"	A	6.50	6.50	6.50
			B0	2.50	2.50	2.70
			B1	3.00	3.00	3.00
			B2	3.50	3.40	3.50
		3"	A	8.25	8.25	8.25
			B0	3.48	3.48	3.20
			B1	3.48	3.48	3.60
			B2	4.10	4.00	4.00
	Class 600#	1"	A	4.88	4.50	5.25
			B0	2.50	2.15	2.26
			B1	3.00	2.15	2.26
			B2	3.50	2.40	2.50
		1-1/2"	A	6.12	6.12	5.25
			B0	2.50	1.53	2.50
			B1	3.00	2.09	3.00
			B2	3.50	2.49	3.50
		2"	A	6.50	6.50	6.50
			B0	3.10	3.10	3.30
			B1	3.60	3.60	3.60
			B2	4.10	4.00	4.10
		3"	A	8.25	8.25	8.25
			B0	3.48	3.48	3.20
			B1	3.48	3.48	3.60
			B2	4.10	4.00	4.00

B0 Without Flush  
 B1 B Dimension with 1/4 NPT Flushing Connection  
 B2 B dimension with 1/2 NPT Flushing Connection

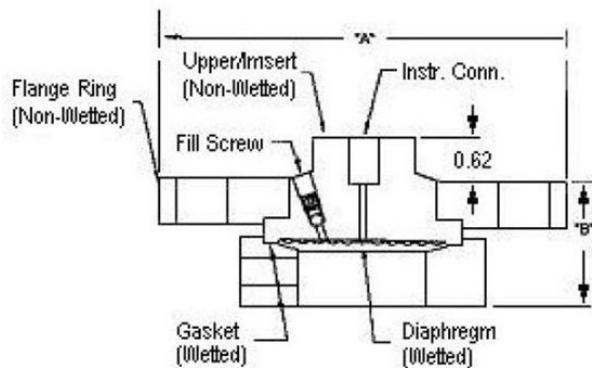

**Flush Flanged Seal with Lower**

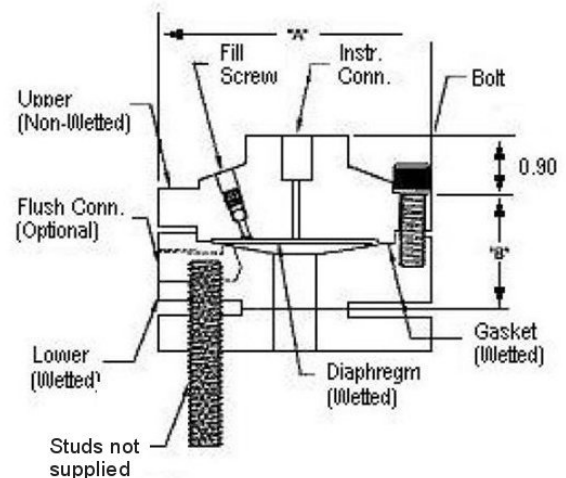

**Flush Flanged Seal with Lower**  
 Note: 0.90 dimension is 0.70 for 4.1" Dia Diaphragm

**Figure 10- Seal Dimension (Flush Flanged)**

Reference Dimensions (cont'd)

Flanged Seal with Extended Diaphragm

Type	ANSI/DIN Rating	Dimension	2.8" Diaphragm Dia. (in.)	3.5" Diaphragm Dia. (in.)
Flanged Seal with Extended Diaphragm	3" Class 150#	A	7.50	-
		B	0.94	-
		C	2.80	-
	3" Class 300#	A	8.25	-
		B	1.12	-
		C	2.80	-
	DIN DN80-PN40	A	7.87	-
		B	0.94	-
		C	2.80	-
	4" Class 150#	A	-	9.00
		B	-	0.94
		C	-	3.70

Designed to meet with schedule 40 pipe

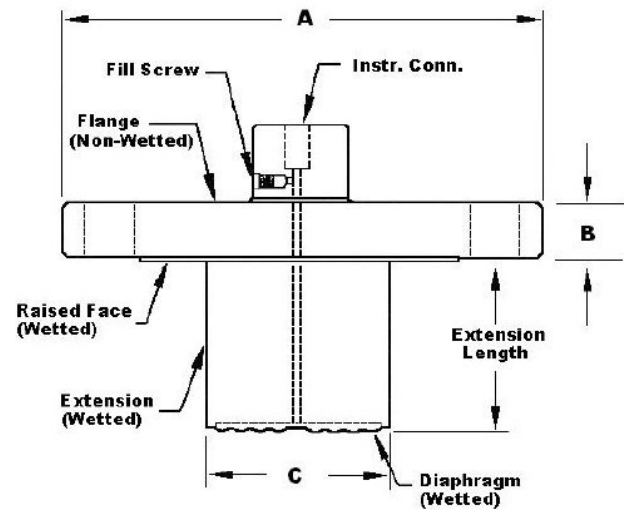


Figure 11 — Seal Dimensions (Extended Diaphragms)

Pancake Seal

Type	ANSI/DIN	Dimension	3.5" Diaph. (in.)
Pancake Seal	Class 150#, 300#, 600# DN80-PN40	A	5.00
		B	1.08

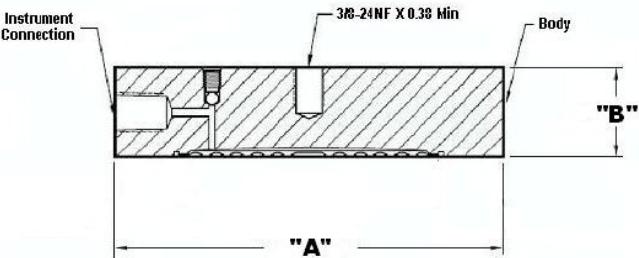


Figure 12 — Seal Dimensions (Pancake)

Chemical Tee "Taylor Wedge" Seal

Type	Size	Dimension	3.5" Diaph. (in.)
Chemical Tee "Taylor Wedge" Seal	750 psi	A	5.00
		B	0.50

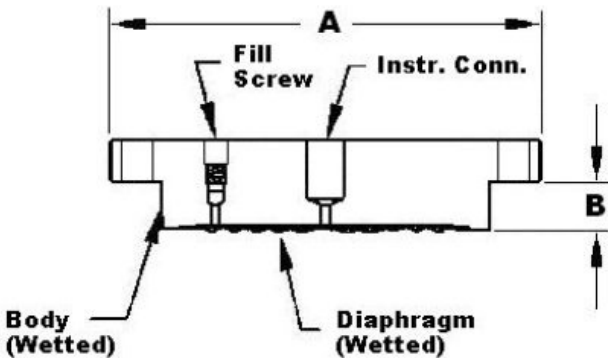


Figure 13 — Seal Dimensions (Chemical TEE "Taylor Wedge" Seals)

### Seal with Threaded Process Connection

Type	Size	Dimension	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Threaded Process Conn. Seal	1/4" or 1/2"	A	3.50	4.00	5.25
		B0	1.66	1.66	1.79
		B1	1.66	1.66	1.79
		B2	2.18	2.18	2.14
	3/4" or 1"	A	3.50	4.00	5.25
		B0	1.66	1.66	1.79
		B1	1.66	1.66	1.79
		B2	8.25	2.18	2.14

B0 Without Flush

B1 B Dimension with 1/4 NPT Flushing Connection

B2 B dimension with 1/2 NPT Flushing Connection

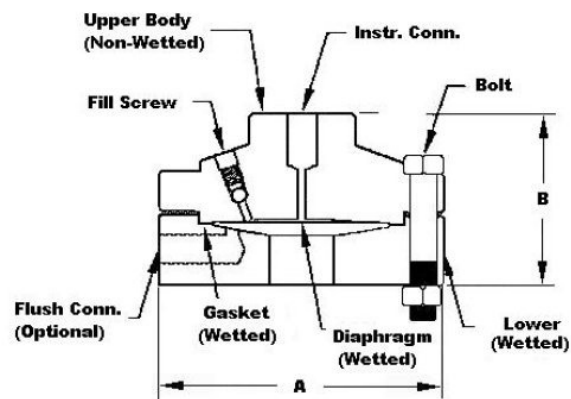


Figure 14— Seal Dimensions (Threaded Process Connection Seals)

### Sanitary Seal

Type	Size	Dimension	1.9" Diaphragm Dia. (in.)	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Sanitary Seal	2"	A	2.50	-	-	-
		B	1.42	-	-	-
	2- 1/2"	A	-	3.00	-	-
		B	-	1.28	-	-
	3"	A	-	-	3.57	-
		B	-	-	1.38	-
	4"	A	-	-	-	4.68
		B	-	-	-	1.60

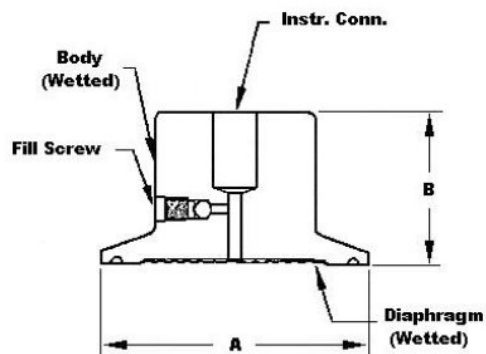


Figure 15— Seal Dimensions (Sanitary Seals)



Saddle Seal

Type	Size	Dimension	2.4" Diaph. (in.)
Saddle Seal	3"	A	3.50
		B	2.90
	4" or larger	A	3.50
		B	3.04

Note: Specify 6 or 8 bolt pattern

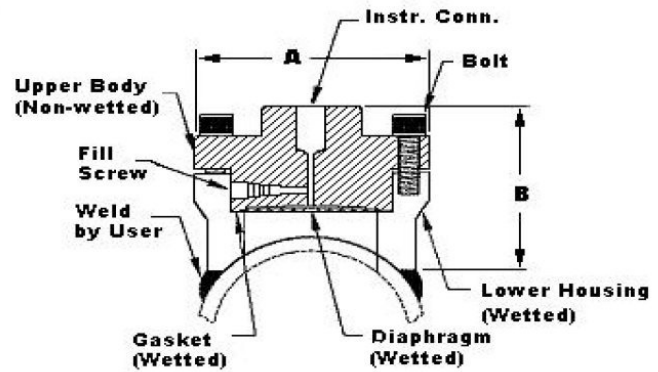


Figure 16— Seal Dimensions (3" Saddle Seal)

Type	Size	Dimension	2.4" Diaph. (in.)
Saddle Seal	3"	A	3.50
		B	2.90
	4" or larger	A	3.50
		B	3.04

Note: Specify 6 or 8 bolt pattern

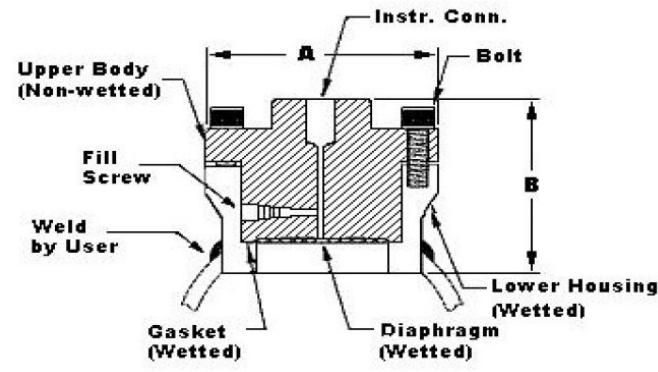


Figure 17— Seal Dimensions (4" Saddle Seal)

Calibration Ring

Type	Size	Rating	Dimension	1/4 NPT	1/2 NPT
Calibration Ring	3"	150# / 800#	A	5.00	5.00
			B	1.00	1.50
			C	3.00	3.00

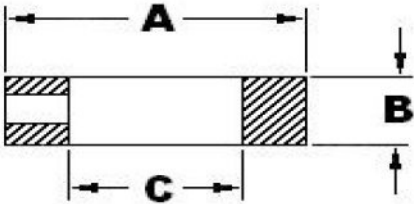


Figure 18— Calibration Ring



## Communications Protocols & Diagnostics

### HART Protocol

#### Version:

HART 7

#### Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms. See [Figure 2](#).

Minimum Load: 0 ohms. (For handheld communications a minimum load of 250 ohms is required)

### Foundation Fieldbus (FF)

#### Power Supply Requirements

Voltage: 9.0 to 32.0Vdc at terminals

Steady State Current: 17.6mAdc

Software Download Current: 27.4mAdc

#### Available Function Blocks

Block Type	Qty	Execution Time
Resource	1	n/a
Transducer	1	n/a
Diagnostic	1	n/a
Analog Input	1*	30 ms
PID w/Autotune	1	45 ms
Integrator	1	30 ms
Signal Char (SC)	1	30 ms
LCD Display	1	n/a
Flow Block	1	30 ms
Input Selector	1	30 ms
Arithmetic	1	30 ms

\* AI block may have two (2) additional instantiations.

All available function blocks adhere to FOUNDATION Fieldbus standards. PID blocks support ideal & robust PID algorithms with full implementation of Auto-tuning.

#### Link Active Scheduler

Transmitters can perform as a backup Link Active Scheduler and take over when the host is disconnected. Acting as a LAS, the device ensures scheduled data transfers typically used for the regular, cyclic transfer of control loop data between devices on the Fieldbus.

#### Number of Devices/Segment

Entity IS model: 6 devices/segment

#### Schedule Entries

18 maximum schedule entries

#### Number of VCR's: 24 max

**Compliance Testing:** Tested according to ITC 6.0.1

### Software Download

Utilizes Class-3 of the Common Software Download procedure as per FF-883 which allows the field devices of any manufacturer to receive software upgrades from any host.

### Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and Hosts.

#### Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms See [Figure 2](#).

### Standard Diagnostics

ST 700 top level diagnostics are reported as either critical or non-critical and readable via the DD/DTM tools or

#### Critical Diagnostics

HART DD/DTM tools	Basic Display
Electronic Module DAC Failure	Electronics Module fault
Meter Body NVM Corrupt	Meterbody fault
Config Data Corrupt	Electronics Module fault
Electronic Module Diag Failure	Electronics Module fault
Meter Body Critical Failure	Meterbody fault
Sensor Comm Timeout	Meterbody Comm fault

#### Non-Critical Diagnostics

HART DD/DTM tools
Display Failure
Electronic Module Comm Failure
Meter Body Excess Correct
Sensor Over Temperature
Fixed Current Mode
PV Out of Range
No Factory Calibration
No DAC Compensation
LRV Set Error – Zero Config Button
URV Set Error – Span Config Button
AO Out of Range
Loop Current Noise
Meter Body Unreliable Comm
Tamper Alarm
No DAC Calibration
Sensor Supply Voltage Low

Refer to ST 700 manuals for additional level diagnostic information

### Other Certification Options

#### Materials

- NACE MRO175, MRO103, ISO15156

## Approval Certifications:

AGENCY	TYPE OF PROTECTION	COMM. OPTION	FIELD PARAMETERS	AMBIENT TEMP (Ta)
<b>FM Approvals™</b>	<b>Explosionproof:</b> Class I, Division 1, Groups A, B, C, D; <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G; T4  Class I, Zone 0/1, AEx d IIC Ga/Gb T4 Class II, Zone 21, AEx tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D, E, F, G; T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	Class I, Zone 0, AEx ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D locations,  Class I, Zone 2, AEx nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-
<b>Canadian Standards Association (CSA)</b>	<b>Explosion Proof:</b> Class I, Division 1, Groups A, B, C, D; <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G; T4  Ex d IIC Ga T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D, E, F, G; T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	Ex ia IIC Ga T4  FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D; T4  Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-

## Approval Certifications: (Continued)

ATEX	<b>Flameproof:</b> II 1/2 G Ex d IIC Ga/Gb T4 II 2 D Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> II 1 G Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> II 3 G Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
IECEX (World)	<b>Flameproof :</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
SAEx (South Africa)	<b>Flameproof :</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure:</b> IP66/ IP67	All	All	-
INMETRO (Brazil)	<b>Flameproof:</b> Ex d IIC Ga/ Gb T4 Ex tb IIIC Db T 95°C	All	Note 1	T5 Ta = -50 to 93°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	T4 Ta = -50 to 93°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	T4 Ta = -50 to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure :</b> IP 66/67	All	All	-

**Approval Certifications: (Continued)**

<b>NEPSI (China)</b>	<b>Flameproof:</b> Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 85°C	All	Note 1	T5 Ta = -50 to 93°C
	<b>Intrinsically Safe:</b> Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Nonincendive:</b> Ex nA IIC Gc T4	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
	<b>Enclosure :</b> IP 66/67	All	All	-
<b>GOST</b>	<b>Flameproof:</b> 1 Ex d IIC Ga/Gb T4 Ex tb IIIC Db T 85°C	All	Note 1	-50 °C to 85°C
	<b>Intrinsically Safe:</b> 0 Ex ia IIC Ga T4	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
	FISCO Field Device (Only for FF Option) Ex ia IIC T4	Foundation Fieldbus	Note 2b	-50 °C to 70°C
	<b>Enclosure :</b> IP 66/67	All	All	

**Notes:**

## 1. Operating Parameters:

Voltage= 11 to 42 V DC      Current= 4-20 mA Normal  
= 10 to 30 V (FF)      = 30 mA (FF)

## 2. Intrinsically Safe Entity Parameters

## a. Analog/ DE/ HART Entity Values:

Vmax= Ui = 30V      Imax= Ii= 105mA      Ci = 4.2nF      Li =984 uH      Pi =0.9W

Transmitter with Terminal Block Revision E or Later )

Vmax= Ui = 30V      Imax= Ii= 225mA      Ci = 4.2nF      Li = 0      Pi =0.9W

Note : Transmitter with Terminal Block Revision E or later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-001 or 50049839-002
- Second line has the supplier information, along with the REVISION:  
XXXXXXX-EXXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.

## b. Foundation Fieldbus- Entity Values

Vmax= Ui = 30V      Imax= Ii= 180mA      Ci = 0nF      Li = 984 uH      Pi =1W

Transmitter with Terminal Block Revision F or Later )

Vmax= Ui = 30V      Imax= Ii= 225mA      Ci =0nF      Li = 0      Pi =1 W

FISCO Field Device      Imax= Ii= 380 mA      Ci = 0nF      Li = 0      Pi =5.32 W

Vmax= Ui = 17.5V

Note : Transmitter with Terminal Block Revision F or later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-003 or 50049839-004
- Second line has the supplier information, along with the REVISION:  
XXXXXXX-EXXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION.

**Approval Certifications: (Continued)**

<b>Marine Certifications</b>	This certificate defines the certifications covered for the SmartLine Pressure Transmitter family of products, including the SMV SmartLine Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications.
	<b>American Bureau of Shipping (ABS)</b> - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	<b>Bureau Veritas (BV)</b> - Product Code: 389:1H. Certificate number: 12660/B0 BV
	<b>Det Norske Veritas (DNV)</b> - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	<b>Korean Register of Shipping (KR)</b> - Certificate number: LOX17743-AE001
	<b>Lloyd's Register (LR)</b> - Certificate number: 02/60001(E1) & (E2)
<b>SIL 2/3 Certification</b>	IEC 61508 SIL 2 for non-redundant use and SIL 3 for redundant use according to EXIDA and TÜV Nord Sys Tec GmbH & Co. KG under the following standards: IEC61508-1: 2010; IEC 61508-2: 2010; IEC61508-3: 2010.

## Application Data

### Liquid Level: Closed Tank

Determine the minimum and maximum pressure differentials to be measured (Figure 16).

$$\begin{aligned} P_{\text{Min}} &= (SG_p \times a) - (SG_f \times d) \\ &= \text{LRV when HP at bottom of tank} \\ &= -\text{URV when LP at bottom of tank} \end{aligned}$$

$$\begin{aligned} P_{\text{Max}} &= (SG_p \times b) - (SG_f \times d) \\ &= \text{URV when HP at bottom of tank} \\ &= -\text{LRV when LP at bottom of tank} \end{aligned}$$

Where:

minimum level at 4mA  
maximum level at 20 mA

a = distance between bottom tap and minimum level

b = distance between bottom tap and maximum level

d = distance between taps

$SG_f$  = Specific Gravity of capillary fill fluid (See Page 6 "Material Specifications" for values.)

$SG_p$  = Specific Gravity of process fluid

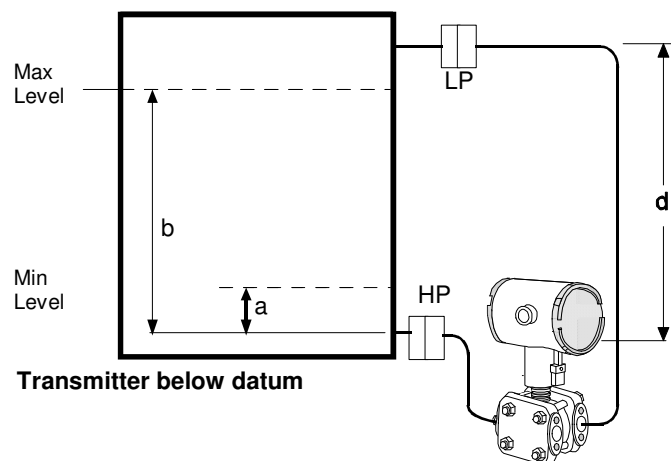
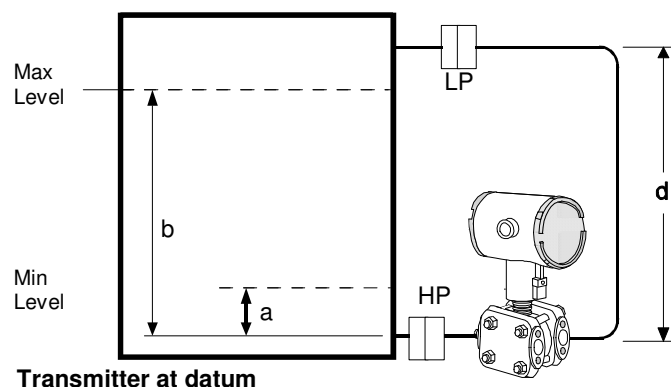
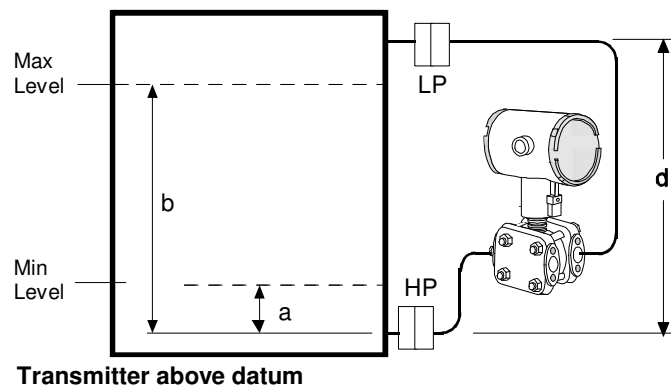


Figure 16—Closed tank liquid level measurement distance

24253

## Application Data (Cont'd)

### Density or Interface\*

Calculate the minimum and maximum pressure differentials to be measured (Figure 19).

$P_{\min} = (SG_{\min} - SG_f) \times (d)$ ;  
minimum density, 4mA output

$P_{\max} = (SG_{\max} - SG_f) \times (d)$ ;  
maximum density, 20mA output


Where:

$d$  = distance between the taps

$SG_{\max}$  = maximum Specific Gravity

$SG_{\min}$  = minimum Specific Gravity

$SG_f$  = Specific Gravity of capillary fill fluid (See Page 6 "Material Specifications" for values.)

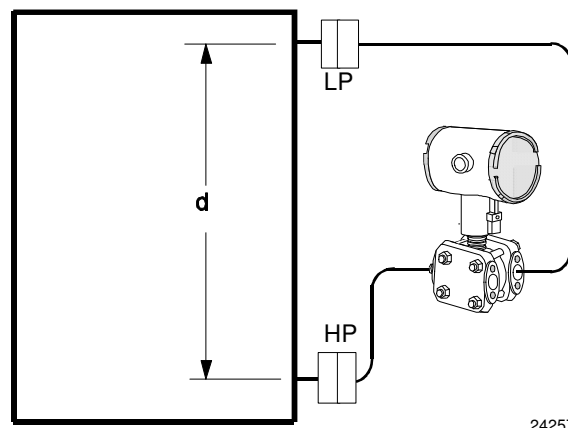

24257

**Figure 19- Density, direct acting transmitter configuration**

## Seal Configurations



**Figure 20—Flush Flange Seals**

Flush Flange Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, ANSI Class 300 and DIN DN80-PN40 process connections. Flush flange seals can also be provided with Lowers. Lowers are essentially calibration rings, which allow flushing connections if needed.



**Figure 22—Pancake Seals**

Pancake Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, 300 and 600 process connections.



**Figure 21 — Flange Seal with Extended Diaphragm**

Flange Seal with Extended Diaphragm can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" ANSI Class 150, ANSI Class 300, DIN DN80-PN40 and DIN DN100-PN40 process connections. 2", 4" and 6" extension lengths are available



**Figure 23— Chemical Tee "Taylor" Wedge**

Chemical Tee "Taylor" Wedge can be used with differential pressure transmitters and are available with Taylor Wedge 5" O.D. process connection.



## Seal Configurations (cont'd)



**Figure 24— Seals with Threaded Process Connections**

Seals with Threaded Process Connections can be used with differential, gauge and absolute pressure transmitters and are available with 1/2", 3/4" and 1" NPT Female process connections.



**Figure 25 — Sanitary Seals**

Sanitary Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" Tri-Clover-Tri-Clamp process connections.



**Figure 26— Saddle Seals**

Saddle Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" (6 bolt or 8 bolt designs) process connections.



**Figure 27 — Calibration Rings**

Calibration Rings are available with Flush Flange Seals and Pancake Seals. Flushing ports (1/4" or 1/2") are available with calibration rings.



**Figure 28 — Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries**

Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries are available with Honeywell Remote Seal Solutions.



**Figure 29 — 2" Stainless Steel Nipples**  
2" Stainless Steel Nipples are available for Close-Coupled remote seal solutions



**Figure 30 — Welded Meter Body for All-Welded Remote Seal Solution**

Welded Meter Body for All-Welded Remote Seal Solution. The welded ST 700 meter body is an important part of an All-Welded Remote Seal Solution, which is commonly used in Vacuum applications.

## Model Selection Guide

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.

Prior to specifying or ordering a model check for the latest revision Model Selection Guides which are published at:

[www.honeywellprocess.com/en-US/pages/default.aspx](http://www.honeywellprocess.com/en-US/pages/default.aspx)

## Model STR700 (DP, GP) Remote Seals



Model Selection Guide  
34-ST-16-104 Issue 8

### Instructions

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IX) using the column below the proper arrow.
- A (●) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IX.

Key Number	I	II	III	IV	V	VI	VII	VIII	IX
STR7__	-	-	-	-	-	-	-	-	0000

KEY NUMBER	URL	LRL	Max Span	Min Span	Units	Selection	Availability
Measurement	100 (7)	-100 (-7)	100 (7)	0.9 (0.062)	psi (bar)	STR73D	↓
Range Std Accuracy	500 (35)	-14.7 (-1.0)	500 (35)	5 (0.35)	psi (bar)	STR74G	↓

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE I	Description		Selection				
Meter Body & Capillaries	a. Number of Seals	1 Remote Seal (High Side)	1	_____	•	•	
		2 Remote Seals	2	_____	•		
		1 Remote Seal (Low Side)	3	_____	•		
	b. Primary Fill Fluid (Meter body)	Silicone Oil 200	1	_____	•	•	
		Fluorinated Oil CTFE	2	_____	2	2	
		Silicone Oil 704	3	_____	•		
		NEOBEE® M-20 <sup>11</sup>	4	_____	•	•	
	c. Construction	Non-Wetted Adapter Head Materials					
	In-Line Gauge	316 SS Bonnet	A	_____		•	
		316 SS Bonnet for Close-Couple	B	_____		3	
	Dual Head DP	316 SS (bolt-on heads)	C	_____		•	
		316 SS for Close-Couple	D	_____		3	
		316 SS with all-welded meter body	E	_____		4	
		None	0	_____		22	•
	d. Bolts and Nuts for Transmitter Heads	Carbon Steel Bolts and Nuts	C	_____		•	
		316 SS Bolts and Nuts	S	_____		•	
		A286 SS (NACE) Bolts and 304 SS (NACE) Nuts	N	_____		•	
		B7M (NACE) Bolts and 7M (NACE) Nuts	B	_____		•	
	e. Secondary Fill Fluid (capillary & seal)	No Fill Fluid	0	_____		5	5
		Silicone Oil 200	1	_____		•	•
		Fluorinated Oil CTFE	2	_____		•	•
		Silicone Oil 704	3	_____		•	•
		Neobee® M20 <sup>11</sup>	4	_____		•	•
Syltherm® 800 <sup>12</sup>		5	_____		•	•	
f. Connection of Remote Seal to Meter Body	No Capillary, No Nipple (Specify for VAM Unit Only)		0	_____	5	5	
	Capillary Length	5 feet 1.5 m	SS Armor	A	_____	•	•
		10 feet 3.0 m		B	_____	•	•
		15 feet 4.5 m		C	_____	•	•
		20 feet 6.1 m		D	_____	•	•
		25 feet 7.5 m		E	_____	•	•
		35 feet 10.7 m	F	_____	•	•	
		5 feet 1.5 m	PVC Coated SS Armor	G	_____	•	•
		10 feet 3.0 m		H	_____	•	•
		15 feet 4.5 m		J	_____	•	•
		20 feet 6.1 m		K	_____	•	•
	25 feet 7.5 m	L		_____	•	•	
	35 feet 10.7 m	M	_____	•	•		
	2 inch long SS nipple close-coupled		2	_____	6	6	
	g. Seal Option	None	0	_____		•	
		Std Gold Plated Seal Diaph. = 50 µin	1	_____		7	7
		Teflon Coated Seal Diaphragm - only for anti-sticking	4	_____		7	7

<sup>11</sup> Limited vacuum availability.

<sup>12</sup> Minimum static pressure requirement. No vacuum allowed. See Specifications 34-ST-03-88 Figure 15



In-Line Gauge



Dual Head DP



All welded

STR74G  
STR73D

**Note:** When selecting required seal, you must specify only the 9 selections within the required seal type.

Selection



TABLE II		Description									
Seals	No Seal Attached to Core Transmitter (Specify for VAM Unit Only)					0 0 0 0 0 0 0 0		21	21		
	<div>Seal Type</div> <div></div> <div>Flush Flanged Seal</div>	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>		Selection					
				3.5"	3"	ANSI Class 150 ANSI Class 300		AFA _____ AFC _____		•	•
					80mm	DIN DN80-PN40		AFM _____		•	•
		Wetted Material			Diaphragm	Upper Insert	Selection				
					316L SS	316L SS	AA _____		•	•	
					Hastelloy® C-276	316L SS	AB _____		•	•	
					Hastelloy® C-276	Hastelloy® C-276	AC _____		•	•	
					Monel 400®	Monel 400®	AE _____		8	8	
					Tantalum <sup>5</sup>	316L SS	AF _____		8	8	
		Non-Wetted Material (upper)		CS (Nickel Plated) 316L SS		1 _____ 2 _____		•	•		
		Seal-Capillary Connection		Center Seal Side Seal		1 _____ 2 _____		•	•		
		Calibration Rings		None 316L SS Hastelloy® C-276 Monel 400®		A _____ B _____ C _____ D _____		•	•		
		<div></div>						10	10		
								10	10		
								10	10		
		Flushing		None		0 _____		•	•		
Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Cal. ring material if metal plug is chosen )		One 1/4" with plastic plug One 1/4" with metal plug Two 1/4" with plastic plugs Two 1/4" with metal plugs One 1/2" with plastic plug One 1/2" with metal plug Two 1/2" with plastic plugs Two 1/2" with metal plugs		H _____ J _____ M _____ N _____ P _____ Q _____ R _____ S _____		11	11				

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>5</sup> Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.


							STR74G			
							STR73D			
Seals (continued)	TABLE II					Description			Selection	
	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>	Const. - See Spec. Figure 34-ST-03-104	Construction - See Spec. Figure 34-ST-03-104				
	 Flush Flanged Seal with Lower	2.4"	1"	ANSI 150 ANSI 300	22 22	BCA _____ BCC _____	•	•		
			1-1/2"	ANSI 150 ANSI 300	22 22	BGA _____ BGC _____	•	•		
				2"	ANSI 150 ANSI 300	22 22	BDA _____ BDC _____	•	•	
			3"		ANSI 150 ANSI 300	22 22	BFA _____ BFC _____	•	•	
		2.9"		1/2"	ANSI 150	23	CAA _____	•	•	
			1"	ANSI 150 ANSI 300	23 23	CCA _____ CCC _____	•	•		
				1-1/2"	ANSI 150 ANSI 300	22 22	CGA _____ CGC _____	•	•	
			2"		ANSI 150 ANSI 300	22 22	CDA _____ CDC _____	•	•	
				4.1"	1/2"	ANSI 150	22	DAA _____	•	•
			1"		ANSI 150 ANSI 300	23 23	DCA _____ DCC _____	•	•	
		1-1/2"			ANSI 150 ANSI 300	23 23	DGA _____ DGC _____	•	•	
			2"		ANSI 150 ANSI 300	23 22	DDA _____ DDC _____	•	•	
		3"			ANSI 150 ANSI 300	22 22	DFA _____ DFC _____	•	•	
			Wetted Material		Diaphragm	Lower	Selection			
		316L SS			316L SS	___ BA ___	•	•		
		Hastelloy® C-276			316L SS	___ BB ___	•	•		
		Hastelloy® C-276			Hastelloy® C-276	___ BC ___	•	•		
		Monel 400®			Monel 400®	___ BE ___	8	8		
		Tantalum			316L SS	___ BF ___	8	8		
		Non-Wetted Material (upper, upper insert)		Upper	Upper Insert	Selection				
				316L SS	316L SS	___ 4 ___	•	•		
				Carbon Steel	316L SS	___ 5 ___	•	•		
		Bolts <sup>6</sup>		No Selection		___ 0 ___	•	•		
		Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)		None		___ 0 ___	•	•		
				One 1/4" with plastic plug		___ H ___	•	•		
				One 1/4" with metal plug		___ J ___	•	•		
				Two 1/4" with plastic plugs		___ M ___	•	•		
				Two 1/4" with metal plugs		___ N ___	•	•		
				One 1/2" with plastic plug		___ P ___	•	•		
				One 1/2" with metal plug		___ Q ___	•	•		
				Two 1/2" with plastic plugs		___ R ___	•	•		
		Gasket		Klinger® C-4401 (non-asbestos)		___ K ___	•	•		
				Grafoil®		___ G ___	•	•		
				Teflon®		___ T ___	•	•		
				Gylon® 3510		___ L ___	15	15		

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.<sup>6</sup> Bolt material will be same as Upper Material. However, if Table I bolts/nuts material is NACE or B7M, seal bolt material will be 304 SS NACE.<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

STR74G

STR73D


TABLE II	Description							
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>		Selection		
	 <div>Flange Seal with Extended Diaphragm</div>	2.8"	3" (2.8" OD extension)	ANSI Class 150		EFA _____	•	•
				ANSI Class 300		EFC _____	•	•
				DIN DN80-PN40		EFM _____	•	•
		3.5"	4" (3.70" OD extension)	ANSI Class 150		FGA _____	•	•
				ANSI Class 300		FGC _____	•	•
				DIN DN100-PN40		FGP _____	•	•
		Wetted Material		Diaphragm	Ext. Tube	Selection		
				316L SS	316L SS	___ EA ___	•	•
				Hastelloy® C-276	316L SS	___ EB ___	•	•
				Hastelloy® C-276	Hastelloy® C-276	___ EC ___	•	•
	Non-Wetted Material (flange)		CS (Nickel Plated)		___ 7 ___	•	•	
			316L SS		___ 8 ___	•	•	
	Bolts		No Selection		___ 0 ___	•	•	
Extension Length		2"		___ 2 ___	•	•		
		4"		___ 4 ___	•	•		
		6"		___ 6 ___	•	•		
No Selection	No Selection	No Selection		___ 0 ___	•	•		

Table II continued below


TABLE II		Description					
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating Dependent on Customer Flange <sup>1</sup>		Selection	
		3.5"	3"	ANSI Class 150/300/600		GFA _____	•
		Wetted Material		Diaphragm	Body	Selection	
				316L SS	316L SS	___ GA ___	•
				Hastelloy® C-276	316L SS	___ GB ___	•
				Hastelloy® C-276	Hastelloy® C-276	___ GC ___	•
				Monel 400®	Monel 400®	___ GE ___	8
				Tantalum	Tantalum <sup>7</sup>	___ GG ___	8
		Non-Wetted Material		No Selection		___ 0 ___	•
		Bolts		No Selection		___ 0 ___	•
		Calibration Rings		None		___ A ___	•
				316L SS		___ B ___	10
				Hastelloy® C-276		___ C ___	10
				Monel 400®		___ D ___	10
		Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Cal. Ring material, if metal plug is chosen )		None		___ 0 ___	•
				One 1/4" with plastic plug		___ H ___	11
				One 1/4" with metal plug		___ J ___	11
				Two 1/4" with plastic plugs		___ M ___	11
				Two 1/4" with metal plugs		___ N ___	11
				One 1/2" with plastic plug		___ P ___	11
				One 1/2" with metal plug		___ Q ___	11
				Two 1/2" with plastic plugs		___ R ___	11
				Two 1/2" with metal plugs		___ S ___	11

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation<sup>7</sup> Tantalum Body has Tantalum wetted parts and 316 SS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.


TABLE II		Description					
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>		Selection	↓
	 Chemical Tee "Taylor" Wedge	3.5"	Taylor Wedge 5" O.D.	750 psi		HMO _____	16
		Wetted Material	Diaphragm	Body	Selection		
			316L SS	316L SS	___ HA ___		•
			Hastelloy® C-276	316L SS	___ HB ___		•
			Hastelloy® C-276	Hastelloy® C-276	___ HC ___		•
		Non-Wetted Material	No Selection		___ 0 ___		•
		Bolts	No Selection		___ 0 ___		•
		Styles	No Selection		___ 0 ___		•
No Selection	No Selection		0		•		

Table II continued below


		STR74G					STR73D		
TABLE II		Description							
Seals (continued)	Seal Type	Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Pressure Rating		Selection			
				CS Bolts	304 SS Bolts				
	 Seal with Threaded Process Connection	2.4"	1/2 NPT	2,500 psi	1,250 psi	JJG _____	•	•	
			3/4 NPT			JKG _____	•	•	
			1 NPT			JLG _____	•	•	
			2.9"	1/2 NPT	2,500 psi	1,250 psi	KJG _____	•	•
				3/4 NPT			KKG _____	•	•
				1 NPT			KLK _____	•	•
			4.1"	1/2 NPT	1,500 psi	750 psi	LJG _____	•	•
				3/4 NPT			LKG _____	•	•
				1 NPT			LLG _____	•	•
		Wetted Material	Diaphragm		Lower		Selection		
			316L SS		Carbon Steel		____ JA ____	•	•
			316L SS		316L SS		____ JB ____	•	•
			Hastelloy® C-276		316L SS		____ JC ____	•	•
			Hastelloy® C-276		Hastelloy® C-276		____ JD ____	•	•
			Monel 400®		Monel 400®		____ JE ____	8	8
			Tantalum		316L SS		____ JF ____	8	8
			Tantalum		Hastelloy® C-276		____ JG ____	8	8
			Non-Wetted Material (upper)		CS (Nickel Plated)		____ A ____	•	•
				316 Stainless Steel		____ C ____	17	17	
		Bolts <sup>8</sup>		Carbon Steel		____ C ____	•	•	
				304 SS		____ D ____	•	•	
		Flushing		None		____ 0 ____	•	•	
		Connections and Plugs <sup>4</sup>				____ H ____	•	•	
		(Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)		One 1/4" with plastic plug		____ J ____	•	•	
				One 1/4" with metal plug		____ M ____	•	•	
				Two 1/4" with plastic plugs		____ N ____	•	•	
		Two 1/4" with metal plugs		____ P ____	18	18			
		One 1/2" with plastic plug		____ Q ____	18	18			
		One 1/2" with metal plug		____ R ____	18	18			
		Two 1/2" with plastic plugs		____ S ____	18	18			
		Two 1/2" with metal plugs							
Gasket		Klinger® C-4401 (non-asbestos)		____ K ____	•	•			
		Grafoil®		____ G ____	•	•			
		Teflon®		____ T ____	•	•			
		Gylon® 3510		____ L ____	15	15			

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation<sup>8</sup> If Table I Bolts and Nuts material option is NACE, Bolts and Nuts will ship with Alloy Steel NACE and MAWP may change.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.



TABLE II		Description						
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Pressure Rating		Selection	STR74G	STR73D
		1.9"	2"	Customer clamp rating or 600 psi, whichever is less		MD0 _____	20	19
		2.4"	2-1/2"			NE0 _____	19	19
		2.9"	3"			PF0 _____	19	19
		4.1"	4"			QG0 _____	19	19
		Wetted Material		Diaphragm	Body	Selection		
				316L SS	316L SS	___ N A ___	•	•
		Non-Wetted Material		No Selection		___ 0 ___	•	•
		Bolts		No Selection		___ 0 ___	•	•
		Styles		Tri-Clover Tri-Clamp®		___ 8 ___	•	•
		Gasket		No Selection		___ 0 ___	•	•

Table II continued below

TABLE II		Description					STR74G STR73D	
Seals (continued)	Seal Type	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating		Selection		
				C.S. Bolts	304 SS Bolts			
	 Saddle Seal	2.4" 8-Bolt Design	for 3" Pipe ≥ 4" pipe	2,500 psi	1,250 psi	RFK _____ RGK _____	• •	• •
		2.4" 6-Bolt Design	for 3" Pipe ≥ 4" pipe	2,000 psi	1,000 psi	RPK _____ RQK _____	• •	• •
		Wetted Material		Diaphragm	Lower Housing	Selection		
				316L SS	Carbon Steel	___ RA ___	•	•
				316L SS	316L SS	___ RB ___	•	•
				Hastelloy® C-276	316L SS	___ RC ___	•	•
				Hastelloy® C-276	Hastelloy® C-276	___ RD ___	•	•
				316L SS	N/A-Body Only <sup>10</sup>	___ SB ___	•	•
				Hastelloy® C-276	N/A-Body Only <sup>10</sup>	___ SC ___	•	•
		Non-Wetted Material		Body	Bolts <sup>10,11</sup>	Selection		
				Carbon Steel	Carbon Steel	___ B ___ ___ C ___	8 •	8 •
		316L SS		316 SS				
		Bolts		No Selection		___ 0 ___	•	•
		Styles		No Selection		___ 0 ___	•	•
		Gasket		Klinger® C-4401 (non-asbestos)		___ K ___	•	•
	Grafoil®			___ G ___	•	•		
	Teflon®			___ T ___	•	•		
	Gylon® 3510			___ L ___	•	•		

<sup>9</sup> All sanitary seals have dairy grade 3A approval.<sup>10</sup> Bolts are not included with "body only" selection.<sup>11</sup> If Table I Bolts and Nuts material option is NACE, seal bolt material will be 304 SS NACE.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.



STR74G  
STR73D

0	•	•
A	•	•
B	•	•
C	•	•
D	•	•
E	•	•
F	•	•
G	•	•

TABLE III	Agency Approvals (see data sheet for Approval Code Details)
Approvals	No Approvals Required FM Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof ATEX Explosion proof, Intrinsically Safe & Non-incendive IECEx Explosion proof, Intrinsically Safe & Non-incendive SAE/CCoE Explosion proof, Intrinsically Safe & Non-incendive INMETRO Explosion proof, Intrinsically Safe & Non-incendive NEPSI Explosion proof, Intrinsically Safe & Non-incendive

TABLE IV	TRANSMITTER ELECTRONIC SELECTIONS		
a. Electronic Housing Material & Connection Type	Material	Connection	Lightning Protection
	Polyester Powder Coated Aluminum	1/2 NPT	None
	Polyester Powder Coated Aluminum	M20	None
	Polyester Powder Coated Aluminum	1/2 NPT	Yes
	Polyester Powder Coated Aluminum	M20	Yes
	316 Stainless Steel (Grade CF8M)	1/2 NPT	None
	316 Stainless Steel (Grade CF8M)	M20	None
	316 Stainless Steel (Grade CF8M)	1/2 NPT	Yes
	316 Stainless Steel (Grade CF8M)	M20	Yes
b. Output/ Protocol	Analog Output		Digital Protocol
	4-20mA dc		HART Protocol
	4-20mA dc none		DE Protocol Foundation Fieldbus
c. Customer Interface Selections	Indicator	Ext Zero, Span & Config Buttons	Languages
	None	None	None
	None	Yes (Zero/Span Only)	None
	Basic	None	English
	Basic	Yes	English

A	•	•
B	•	•
C	•	•
D	•	•
E	•	•
F	•	•
G	•	•
H	•	•

_H_	•	•
_D_	•	•
_F_	•	•

_0	•	•
_A	f	f
_B	•	•
_C	•	•

TABLE V	CONFIGURATION SELECTIONS		
a. Application Software	Diagnostics		
	Standard Diagnostics		
b. Output Limit, Failsafe & Write Protect Settings	Write Protect	Fail Mode	High & Low Output Limits <sup>3</sup>
	Disabled	High> 21.0mA dc	Honeywell Std (3.8 - 20.8 mA dc)
	Disabled	Low< 3.6mA dc	Honeywell Std (3.8 - 20.8 mA dc)
	Enabled	High> 21.0mA dc	Honeywell Std (3.8 - 20.8 mA dc)
	Enabled	Low< 3.6mA dc	Honeywell Std (3.8 - 20.8 mA dc)
	Enabled	N/A	N/A Fieldbus
c. General Configuration	Disabled	N/A	N/A Fieldbus
	Factory Standard		
	Custom Configuration (Unit Data Required from customer)		

1	•	•
---	---	---

_1_	f	f
_2_	f	f
_3_	f	f
_4_	f	f
_5_	g	g
_6_	g	g
_S	•	•
_C	•	•

TABLE VI	CALIBRATION & ACCURACY SELECTIONS		
Accuracy and Calibration	Accuracy	Calibrated Range	Calibration Qty
	NA	None	None
	Standard	Factory Std	Single Calibration
	Standard	Custom (Unit Data Required)	Single Calibration

0	21	21
A	•	•
B	•	•

<sup>3</sup> NAMUR Output Limits 3.8 - 20.5mA dc can be configured by the customer or select custom configuration Table Vc

STR74G  
STR73D

TABLE VII	ACCESSORY SELECTIONS	
<b>a. Mounting Bracket</b>	Bracket Type	Material
	None	None
	Angle Bracket	Carbon Steel
	Angle Bracket	304 SS
	Angle Bracket	316 SS
	Marine Approved Bracket	Carbon Steel
	Marine Approved Bracket (In - Line)	Carbon Steel
	Marine Approved Bracket	304 SS
	Marine Approved Bracket (In - Line)	304 SS
	Flat Bracket	Carbon Steel
	Flat Bracket	304 SS
	Flat Bracket	316 SS
<b>b. Customer Tag</b>	Customer Tag Type	
	No customer tag	
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line)	
	Two Wired Stainless Steel Tag (Up to 4 lines 26 char/line)	
<b>c. Unassembled Conduit Plugs &amp; Adapters</b>	Unassembled Conduit Plugs & Adapters	
	No Conduit Plugs or Adapters Required	
	1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter	
	1/2 NPT 316 SS Certified Conduit Plug	
	M20 316 SS Certified Conduit Plug	
	Minifast® 4 pin (1/2 NPT)	
	Minifast® 4 pin (M20)	

0	---	•	•
1	---	•	•
2	---	•	•
3	---	•	•
8	---	y	•
9	---	•	•
4	---	y	•
A	---	•	•
5	---	•	•
6	---	•	•
7	---	•	•

_	0	---	•	•
_	1	---	•	•
_	2	---	•	•

__	A0	•	•
__	A2	n	n
__	A6	n	n
__	A7	m	m
__	A8	n	n
__	A9	m	m

TABLE VIII	OTHER Certifications & Options : (String in sequence comma delimited (XX, XX, XX,...))
<b>Certifications &amp; Warranty</b>	None - No other options
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only
	NACE MR0175; MR0103; ISO15156 (FC33339) wetted and non-wetted parts
	Marine (DNV,ABS,BV,KR,LR)
	EN10204 Type 3.1 Material Traceability (FC33341)
	Certificate of Conformance (F3391)
	Calibration Test Report & Certificate of Conformance (F3399)
	Certificate of Origin (F0195)
	FMEDA (SIL 2/3) Certification (FC33337)
	Over-Pressure Leak Test Certificate (1.5X MAWP) (F3392)
	Cert Clean for O <sub>2</sub> or CL <sub>2</sub> service per AS 1 M G93

00	*	*	
FG	•	•	b
F7	c	c	
MT	d	d	
FX	•	•	b
F3	•	•	
F1	•	•	
F5	•	•	
FE	j	j	
TP	•	•	
OX	e	e	

TABLE IX	Manufacturing Specials
<b>Factory</b>	<b>Factory Identification</b>

0	0	0	0	•	•
---	---	---	---	---	---

## MODEL RESTRICTIONS

Restriction Letter	Available Only With		Not Available With	
	Table	Selection(s)	Table	Selection(s)
<b>b</b>		Select only one option from this group		
<b>d</b>			VIIa	1,2,3,5,6,7
<b>c</b>	Id	___ 0, N, B ___		
<b>e</b>	Ib	___ 2 ___ 2 ___		
<b>f</b>			IVb	___ F ___
<b>g</b>			IVb	___ H, D ___
<b>j</b>	IVb	___ H ___	Vb	___ 1,2,6 ___
<b>m</b>	IVa	B, D, F, H ___		
<b>n</b>	IVa	A, C, E, G ___		
<b>y</b>			Ic	___ E ___
<b>2</b>	Ie	___ 0 ___		
		___ 2 ___		
		___ 4 ___		
<b>3</b>	If	___ 2 ___	Ia	2
<b>4</b>	I	2 ___ 0 ___		
<b>5</b>	VI	0		
			VIII	FG, F7, FX, OX, TP, MT, F1
<b>6</b>	I	___ B, D ___	Ia	2
<b>7</b>			II	___ AF ___
				___ BF ___
				___ BG ___
				___ BH ___
				___ GG ___
				___ JF ___
<b>8</b>			VIII	FG, F7
<b>9</b>	II	___ AA2 ___		
		___ AB2 ___		
<b>10</b>			II	___ 0 ___
<b>11</b>			II	___ A ___
<b>12</b>	If	___ A, G, 2 ___		
<b>13</b>	II	___ 0 ___	II	___ T ___
			VIII	FG, F7
<b>15</b>	II	___ BF ___		
		___ BG ___		
		___ BH ___		
		___ JF ___		
		___ JG ___		
<b>16</b>	I	2		
<b>17</b>			II	___ JA ___
<b>18</b>			II	___ JG ___
				___ JKG ___
				___ JLG ___
<b>19</b>			If	___ 2 ___
<b>20</b>	If	___ A, G ___		
<b>21</b>	I	___ 000		
<b>22</b>	Ic	___ E ___		

FM Approvals<sup>SM</sup> is a service mark of FM Global

Hastelloy<sup>®</sup> is a registered trademark of Haynes International

Monel 400<sup>®</sup> is a registered trademark of Special Metals Corporation.

HART<sup>®</sup> is a registered trademark of HART Communication Foundation.

FOUNDATION<sup>™</sup> Fieldbus is a registered trademark of Fieldbus Foundation.

Teflon<sup>®</sup> is a registered trademark of DuPont.

Neobee<sup>®</sup> is a registered trademark of Stepan Company.

Syltherm<sup>®</sup> 800 is a Trademark of Dow Corning Corporation

Klinger<sup>®</sup> C-4401 is a registered trademark of THERMOSEAL, INC

GRAFOIL<sup>®</sup> is a registered trademarks of GrafTech International Holdings Inc

Gylon<sup>®</sup> 3510 is registered trademark of Garlock Sealing Technologies

Tri-Clover Tri-Clamp<sup>®</sup> is a registered trademark of Alfa-Laval

## Sales and Service

For application assistance, current specifications, pricing, or name of the nearest Authorized Distributor, contact one of the offices below.

### ASIA PACIFIC

Honeywell Process Solutions,  
(TAC) [hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

#### Australia

Honeywell Limited  
Phone: +(61) 7-3846 1255  
FAX: +(61) 7-3840 6481  
Toll Free 1300-36-39-36  
Toll Free Fax:  
1300-36-04-70

#### China – PRC - Shanghai

Honeywell China Inc.  
Phone: (86-21) 5257-4568  
Fax: (86-21) 6237-2826

#### Singapore

Honeywell Pte Ltd.  
Phone: +(65) 6580 3278  
Fax: +(65) 6445-3033

#### South Korea

Honeywell Korea Co Ltd  
Phone: +(822) 799 6114  
Fax: +(822) 792 9015

### EMEA

Honeywell Process Solutions,  
Phone: + 80012026455 or  
+44 (0)1344 656000

Email: (Sales)

[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)

or

(TAC)

[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

### AMERICA'S

Honeywell Process Solutions,  
Phone: (TAC) 1-800-423-9883 or  
215/641-3610  
(Sales) 1-800-343-0228

Email: (Sales)

[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)

or

(TAC)

[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

*Specifications are subject to change without notice.*

**For more information**

To learn more about SmartLine Transmitters,  
visit [www.honeywellprocess.com](http://www.honeywellprocess.com)  
Or contact your Honeywell Account Manager

**Process Solutions**

Honeywell  
1250 W Sam Houston Pkwy S  
Houston, TX 77042

Honeywell Control Systems Ltd  
Honeywell House, Skimped Hill Lane  
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road  
Shanghai, China 20061

[www.honeywellprocess.com](http://www.honeywellprocess.com)

The Honeywell logo, consisting of the word "Honeywell" in a bold, red, sans-serif font.

34-ST-03-104  
December 2014  
©2014 Honeywell International Inc.